
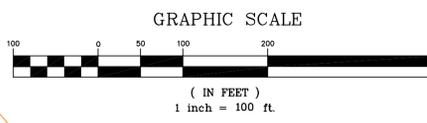


ROAD STATUS:

The Libby Hill Road is described as three rods (49.5') wide in the Kennebec County Commissioner's Records in Volume 5-Page 162 and dated 1824. The original layout did not agree with the existing travel way of the road. This survey held the general line of the stone wall as the apparent right-of-way line.

The Booker Road is described as two and a half rods (41.25') in the Town of Gardiner Record of Streets Book on Page 38 and accepted on April 5, 1829. All the part of Booker Road which extends beyond the north line of James Booker (now Vitali Brinzow) land toward Richmond was discontinued November 9, 1831. The original layout did not agree with the existing travel way of the road and stone walls. This survey held the general line of the stone walls as the apparent right-of-way line.

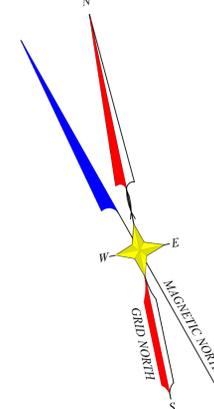

LEGEND

- IRON ROD FOUND
- IRON PIPE FOUND
- DRILL HOLE IN LEDGE
- GRANITE MONUMENT FOUND
- 5/8" REBAR PROPOSED
- 4"x4" GRANITE MONUMENT PROPOSED
- UTILITY POLE
- GUY ANCHOR
- OVERHEAD UTILITY LINE
- BELOW GROUND ELECTRIC
- LIGHT
- HYDRANT
- WATER VALVE
- WELL
- MONITORING WELL
- UNDERGROUND WATER LINE
- SIGN
- EXISTING CONTOUR
- SURVEYED LINE
- STOCKADE FENCE
- WIRE FENCE
- GUARDRAIL
- STONE WALL
- CATCH BASIN
- STORM PIPE
- SANITARY MANHOLE
- SANITARY PUMP STATION
- SANITARY LINE
- SETBACK
- FLAG
- TEST PIT
- CONIFEROUS TREE
- DECIDUOUS TREE
- VEGETATION
- WETLANDS BY VAUGHN SMITH
- PLY JAMES BROWN
- PRIOR OWNER



E.S. COFFIN
ENGINEERING & SURVEYING, INC.
432 Camp Road, Chelsea, Maine 04330
Phone (207) 653-9472 Fax (207) 653-9476

NO.	REVISIONS	DATE


BOUNDARY SURVEY

SCALE: 1 INCH=100 FEET
DATE: MARCH 3, 2025
DRAWN BY: CSC
CHECKED BY: KFC

CLIENT/PROJECT: **THREE MAINERS LLC**
LOCATION: **BOOKER ROAD**
TOWN: **GARDINER** COUNTY: **KENNEBEC** STATE: **MAINE**

PROJ. NO. 2024-110

BS

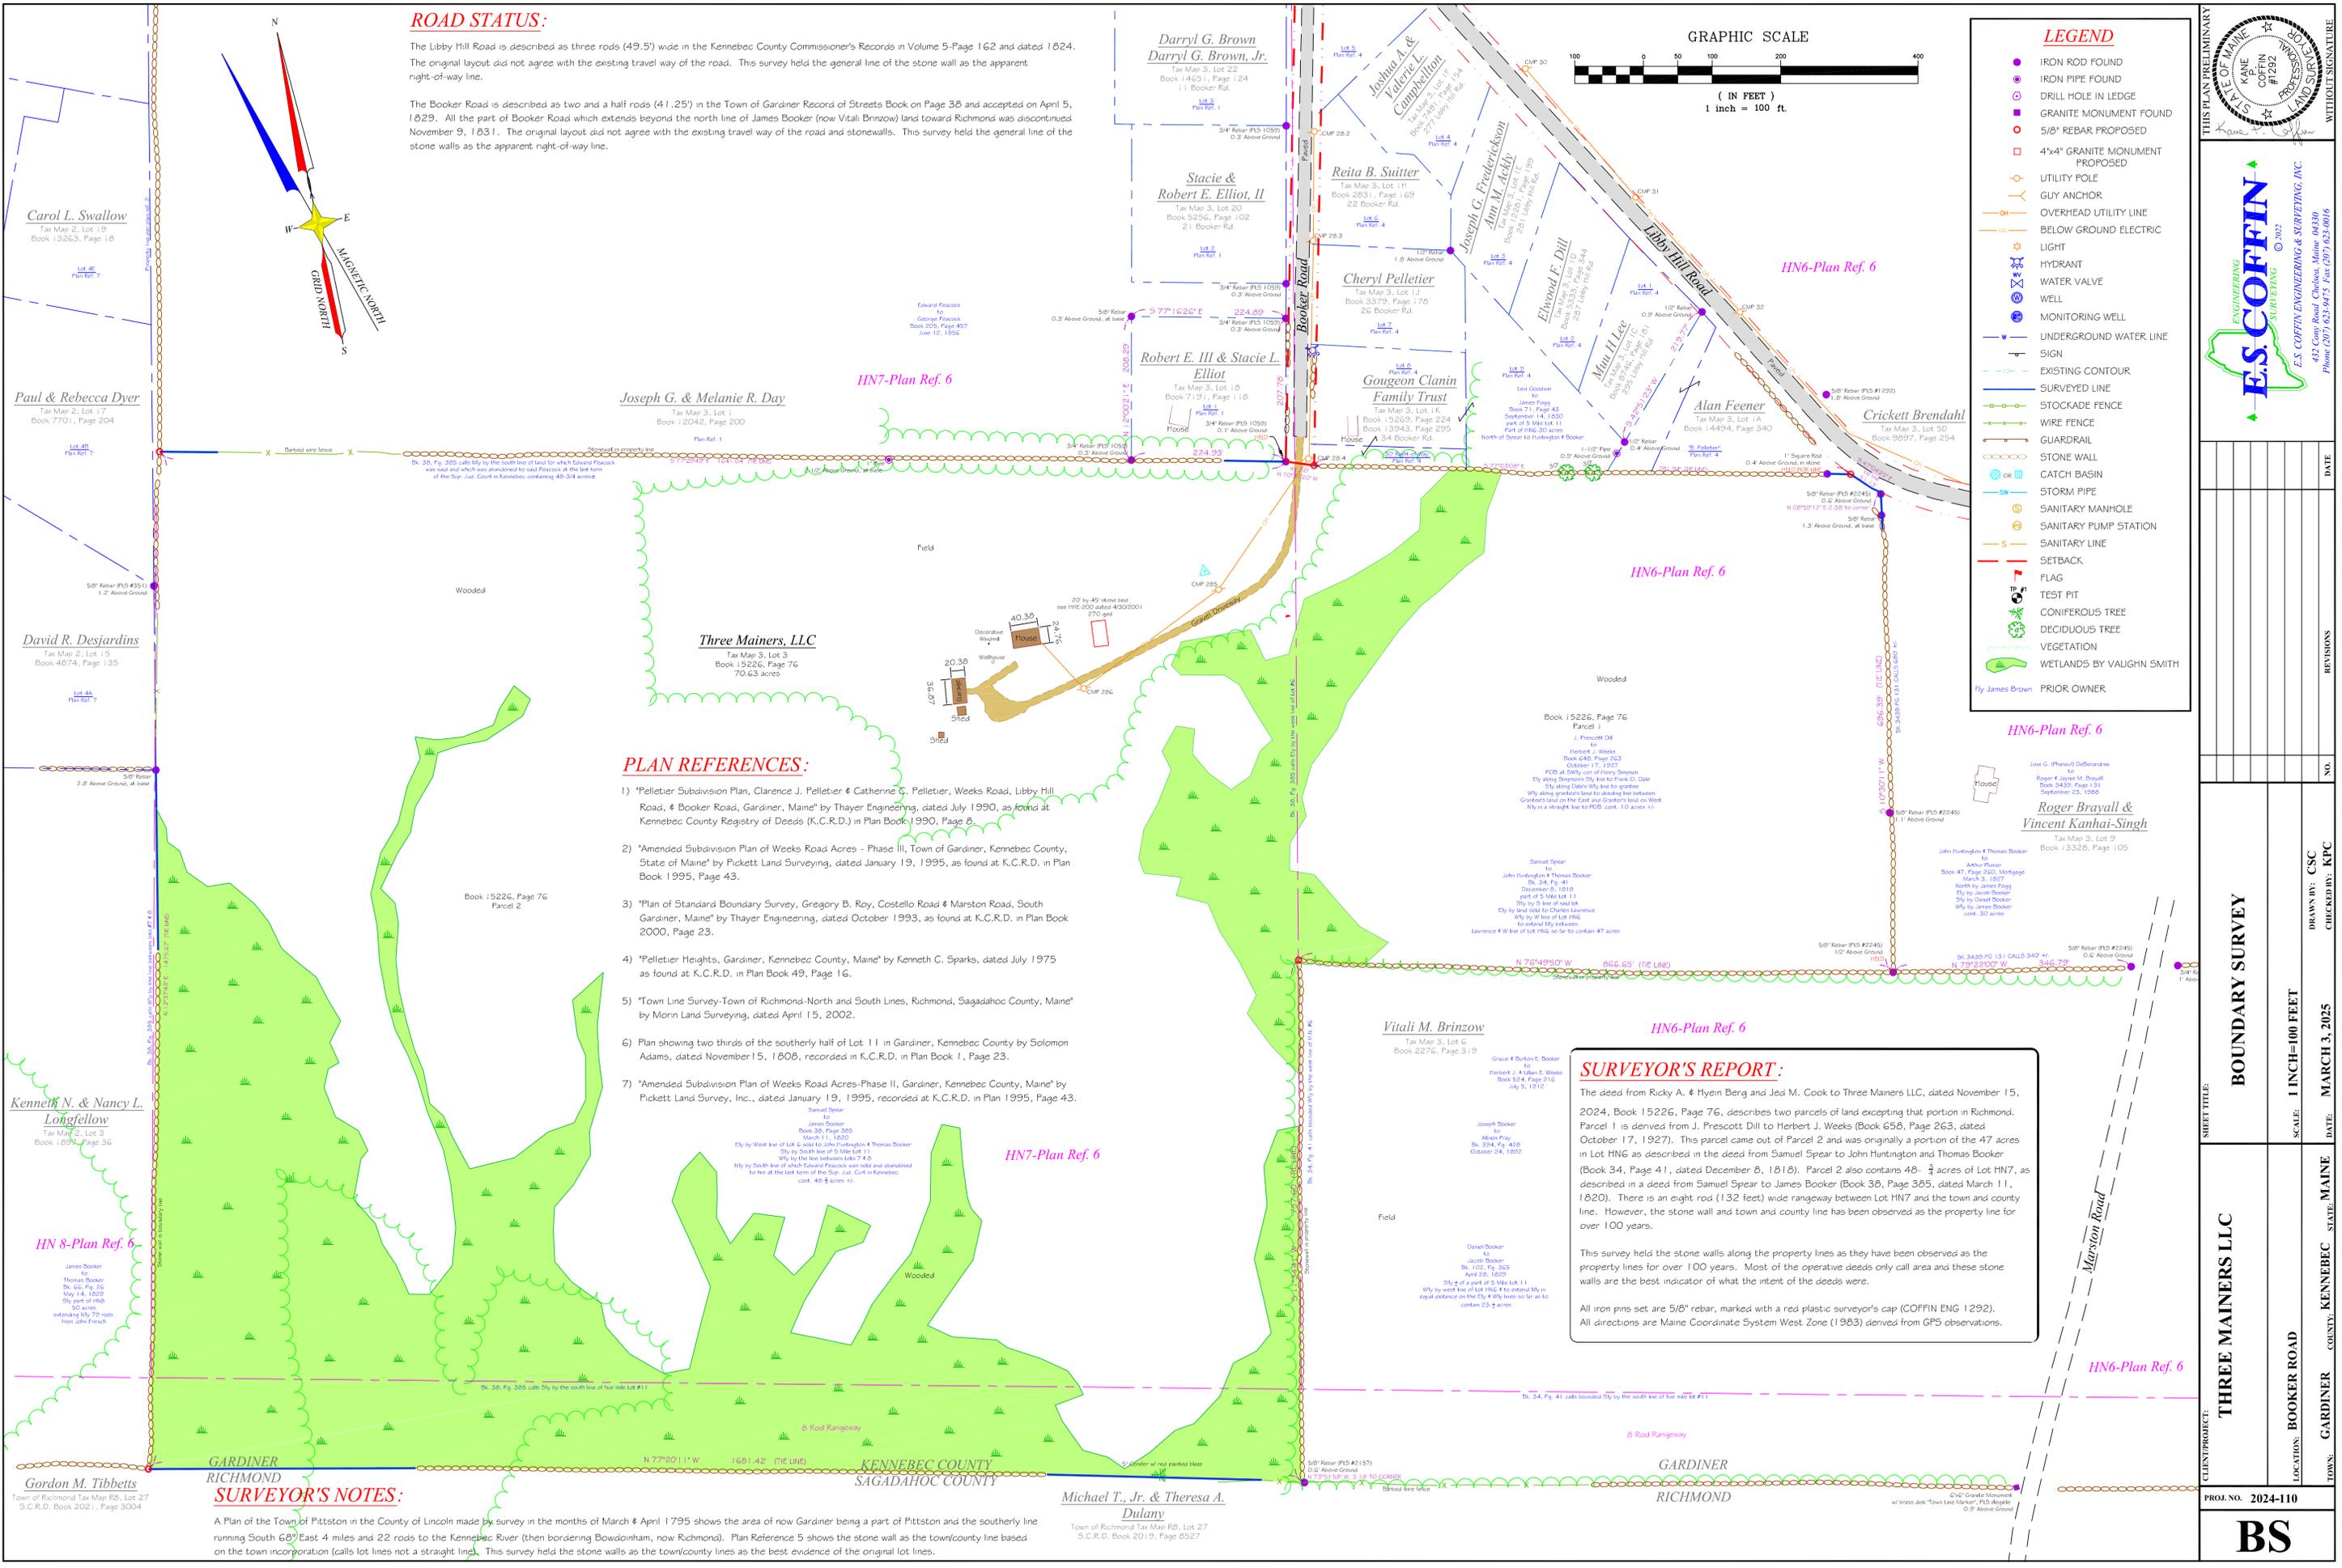

PLAN REFERENCES:

- "Pelletier Subdivision Plan, Clarence J. Pelletier & Catherine C. Pelletier, Weeks Road, Libby Hill Road, & Booker Road, Gardiner, Maine" by Thayer Engineering, dated July 1990, as found at Kennebec County Registry of Deeds (K.C.R.D.) in Plan Book 1990, Page 8.
- "Amended Subdivision Plan of Weeks Road Acres - Phase II, Town of Gardiner, Kennebec County, State of Maine" by Pickett Land Surveying, dated January 19, 1995, as found at K.C.R.D. in Plan Book 1995, Page 43.
- "Plan of Standard Boundary Survey, Gregory B. Roy, Costello Road & Marston Road, South Gardiner, Maine" by Thayer Engineering, dated October 1993, as found at K.C.R.D. in Plan Book 2000, Page 23.
- "Pelletier Heights, Gardiner, Kennebec County, Maine" by Kenneth C. Sparks, dated July 1975 as found at K.C.R.D. in Plan Book 49, Page 16.
- "Town Line Survey-Town of Richmond-North and South Lines, Richmond, Sagadahoc County, Maine" by Morn Land Surveying, dated April 15, 2002.
- Plan showing two thirds of the southerly half of Lot 11 in Gardiner, Kennebec County by Solomon Adams, dated November 15, 1808, recorded in K.C.R.D. in Plan Book 1, Page 23.
- "Amended Subdivision Plan of Weeks Road Acres-Phase II, Gardiner, Kennebec County, Maine" by Pickett Land Survey, Inc., dated January 19, 1995, recorded at K.C.R.D. in Plan 1995, Page 43.

SURVEYOR'S REPORT:

The deed from Ricky A. & Hyein Berg and Jed M. Cook to Three Mainers LLC, dated November 15, 2024, Book 15226, Page 76, describes two parcels of land excepting that portion in Richmond. Parcel 1 is derived from J. Prescott Dill to Herbert J. Weeks (Book 658, Page 263, dated October 17, 1927). This parcel came out of Parcel 2 and was originally a portion of the 47 acres in Lot HNG as described in the deed from Samuel Spear to John Huntington and Thomas Booker (Book 34, Page 41, dated December 8, 1818). Parcel 2 also contains 48.33 acres of Lot HN7, as described in a deed from Samuel Spear to James Booker (Book 38, Page 385, dated March 11, 1820). There is an eight rod (132 feet) wide rangeway between Lot HN7 and the town and county line. However, the stone wall and town and county line has been observed as the property line for over 100 years.

This survey held the stone walls along the property lines as they have been observed as the property lines for over 100 years. Most of the operative deeds only call area and these stone walls are the best indicator of what the intent of the deeds were.

All iron pins set are 5/8" rebar, marked with a red plastic surveyor's cap (COFFIN ENG 1292). All directions are Maine Coordinate System West Zone (1983) derived from GPS observations.

SURVEYOR'S NOTES:



A Plan of the Town of Pittston in the County of Lincoln made by survey in the months of March & April 1795 shows the area of now Gardiner being a part of Pittston and the southerly line running South 68° East 4 miles and 22 rods to the Kennebec River (then bordering Bowdoinham, now Richmond). Plan Reference 5 shows the stone wall as the town/county line based on the town incorporation (calls lot lines not a straight line). This survey held the stone walls as the town/county lines as the best evidence of the original lot lines.

SURVEYOR'S REPORT:

Perimeter boundaries are taken from plan entitled "Boundary Survey-Three Mainers LLC, Booker Road, Gardiner, Kennebec County, Maine" by E.S. Coffin Engineering & Surveying, Inc., dated March 3, 2025. Lots 1-10 comprise 15.79 acres of land and the right-of-way of the road is 1.80 acres of land.

All iron pins set are 5/8" rebar, marked with a red plastic surveyor's cap (COFFIN ENG 1292). All directions are Maine Coordinate System West Zone (1983) derived from GPS observations.

CURVE	RADIUS	LENGTH	DIRECTION	CHORD
C1	125.00	8.13	N29°47'06"E	81.2'
C2	15.00	21.05	S11°23'10"W	19.36'
C3	15.00	23.56	N57°38'50"E	21.21'
C4	15.00	23.56	S32°21'10"E	21.21'
C5	15.00	23.56	S57°38'50"W	21.21'
C6	15.00	23.56	S32°21'10"E	21.21'
C7	15.00	23.56	S57°38'50"W	21.21'
C8	15.00	23.56	N32°21'10"W	21.21'
C9	15.00	21.05	N69°01'11"W	19.36'
C10	225.00	7.34	N71°42'44"E	7.34'
C11	125.00	6.54	N26°08'54"E	6.54'

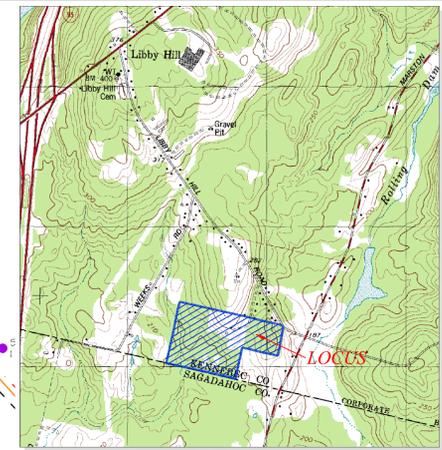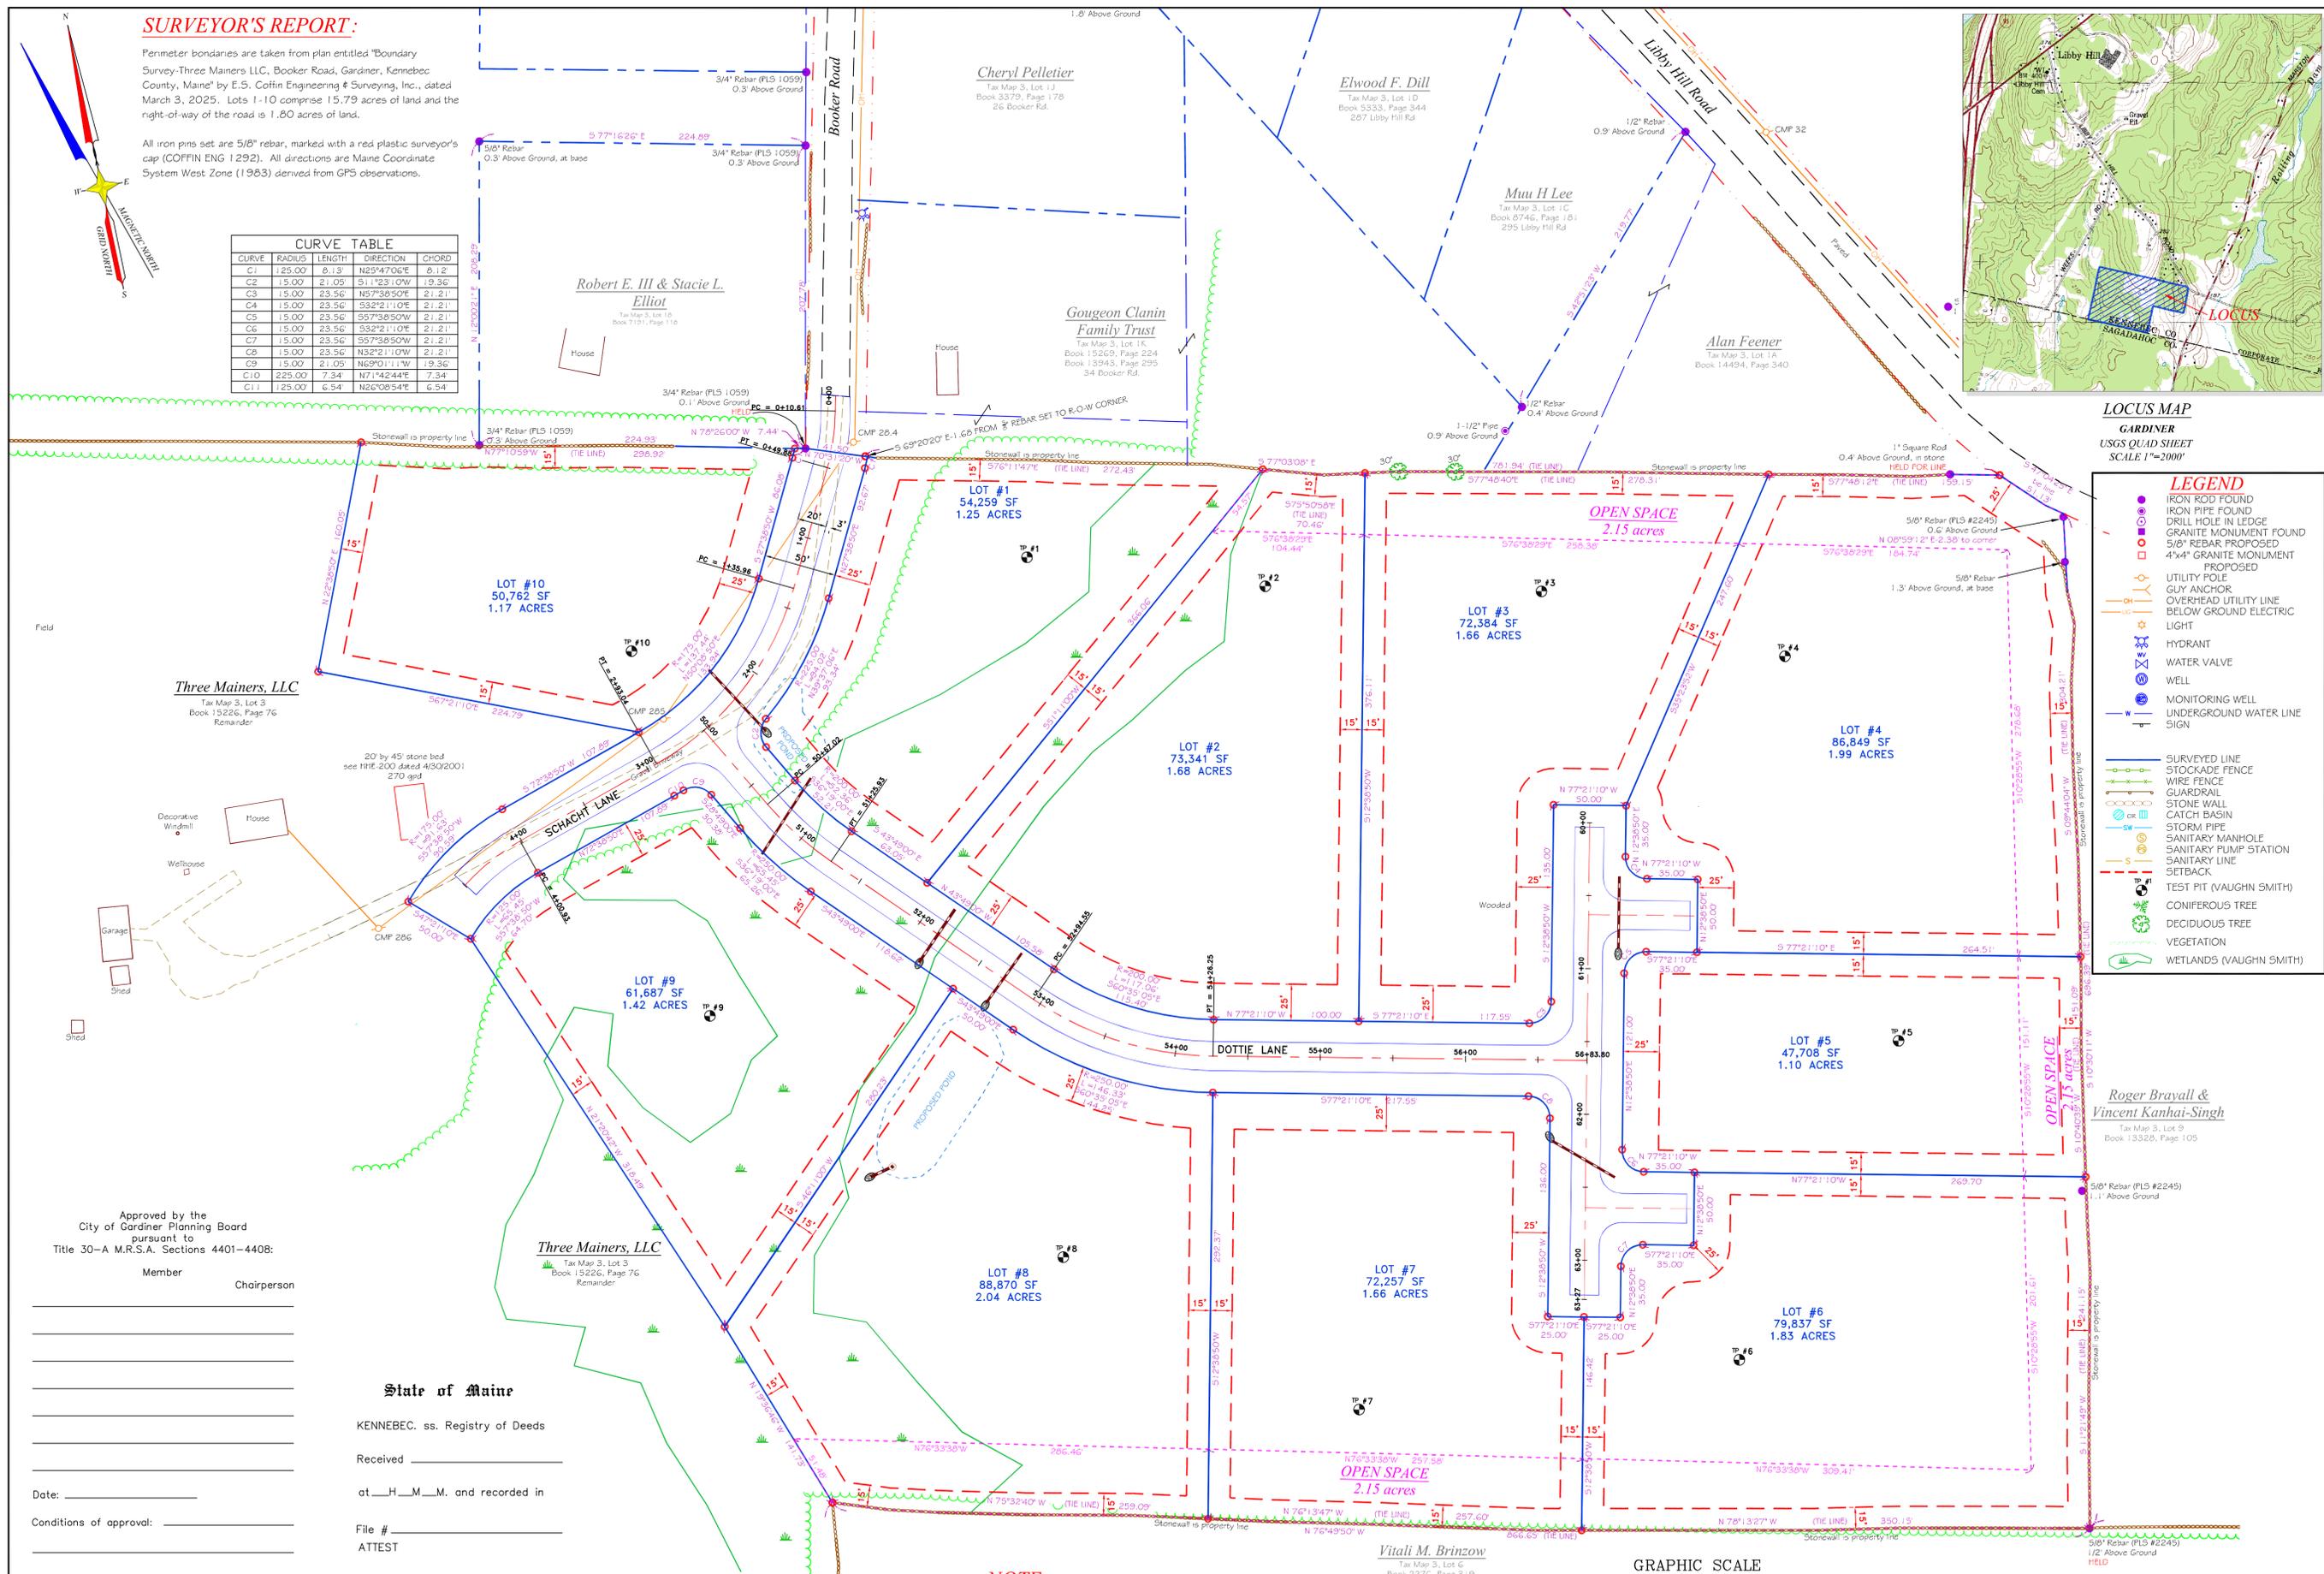

LOCUS MAP
GARDINER
USGS QUAD SHEET
SCALE 1"=2000'

- LEGEND**
- IRON ROD FOUND
 - IRON PIPE FOUND
 - DRILL HOLE IN LEDGE
 - GRANITE MONUMENT FOUND
 - 5/8" REBAR PROPOSED
 - 4"x4" GRANITE MONUMENT PROPOSED
 - UTILITY POLE
 - GUY ANCHOR
 - OVERHEAD UTILITY LINE
 - BELOW GROUND ELECTRIC
 - LIGHT
 - HYDRANT
 - WATER VALVE
 - WELL
 - MONITORING WELL
 - UNDERGROUND WATER LINE
 - SIGN
 - SURVEYED LINE
 - STOCKADE FENCE
 - WIRE FENCE
 - GUARDRAIL
 - STONE WALL
 - CATCH BASIN
 - STORM PIPE
 - SANITARY MANHOLE
 - SANITARY PUMP STATION
 - SANITARY LINE
 - SETBACK
 - TEST PIT (VAUGHN SMITH)
 - CONIFEROUS TREE
 - DECIDUOUS TREE
 - VEGETATION
 - WETLANDS (VAUGHN SMITH)

THIS PLAN PRELIMINARY
KANE
C.P. #1291
PROCESSING
E.S. COFFIN
ENGINEERING & SURVEYING, INC.
432 Camp Road, Chelsea, Maine 04330
Phone (207) 653-9442 Fax (207) 653-9016
WITHOUT SIGNATURE

NO.	REVISIONS	DATE


SHEET TITLE: **RECORDING PLAT**
SCALE: 1 INCH=50 FEET
DRAWN BY: KFC
CHECKED BY: CSC

CLIENT/PROJECT: **THREE MAINERS LLC SUNSET RIDGE SUBDIVISION**
LOCATION: **BOOKER ROAD**
TOWN: **GARDINER** COUNTY: **KENNEBEC** STATE: **MAINE**
PROJ. NO. **2024-110**

Approved by the City of Gardiner Planning Board pursuant to Title 30-A M.R.S.A. Sections 4401-4408:
Member _____
Chairperson _____


State of Maine
KENNEBEC, ss. Registry of Deeds
Received _____
at _____ M. and recorded in _____
Date: _____
Conditions of approval: _____
File # _____
ATTEST _____
REGISTRAR

NOTE:
The proposed roads are designed as private roads and are not eligible for acceptance by the City of Gardiner, unless the roads are improved to meet the appropriate standards for road acceptance.

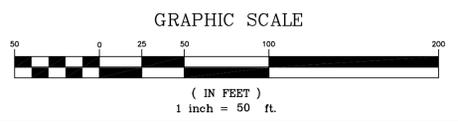

OWNER: **THREE MAINERS LLC**
MAILING ADDRESS: **18 JOSEPH DRIVE SIDNEY, MAINE 04330**

REC

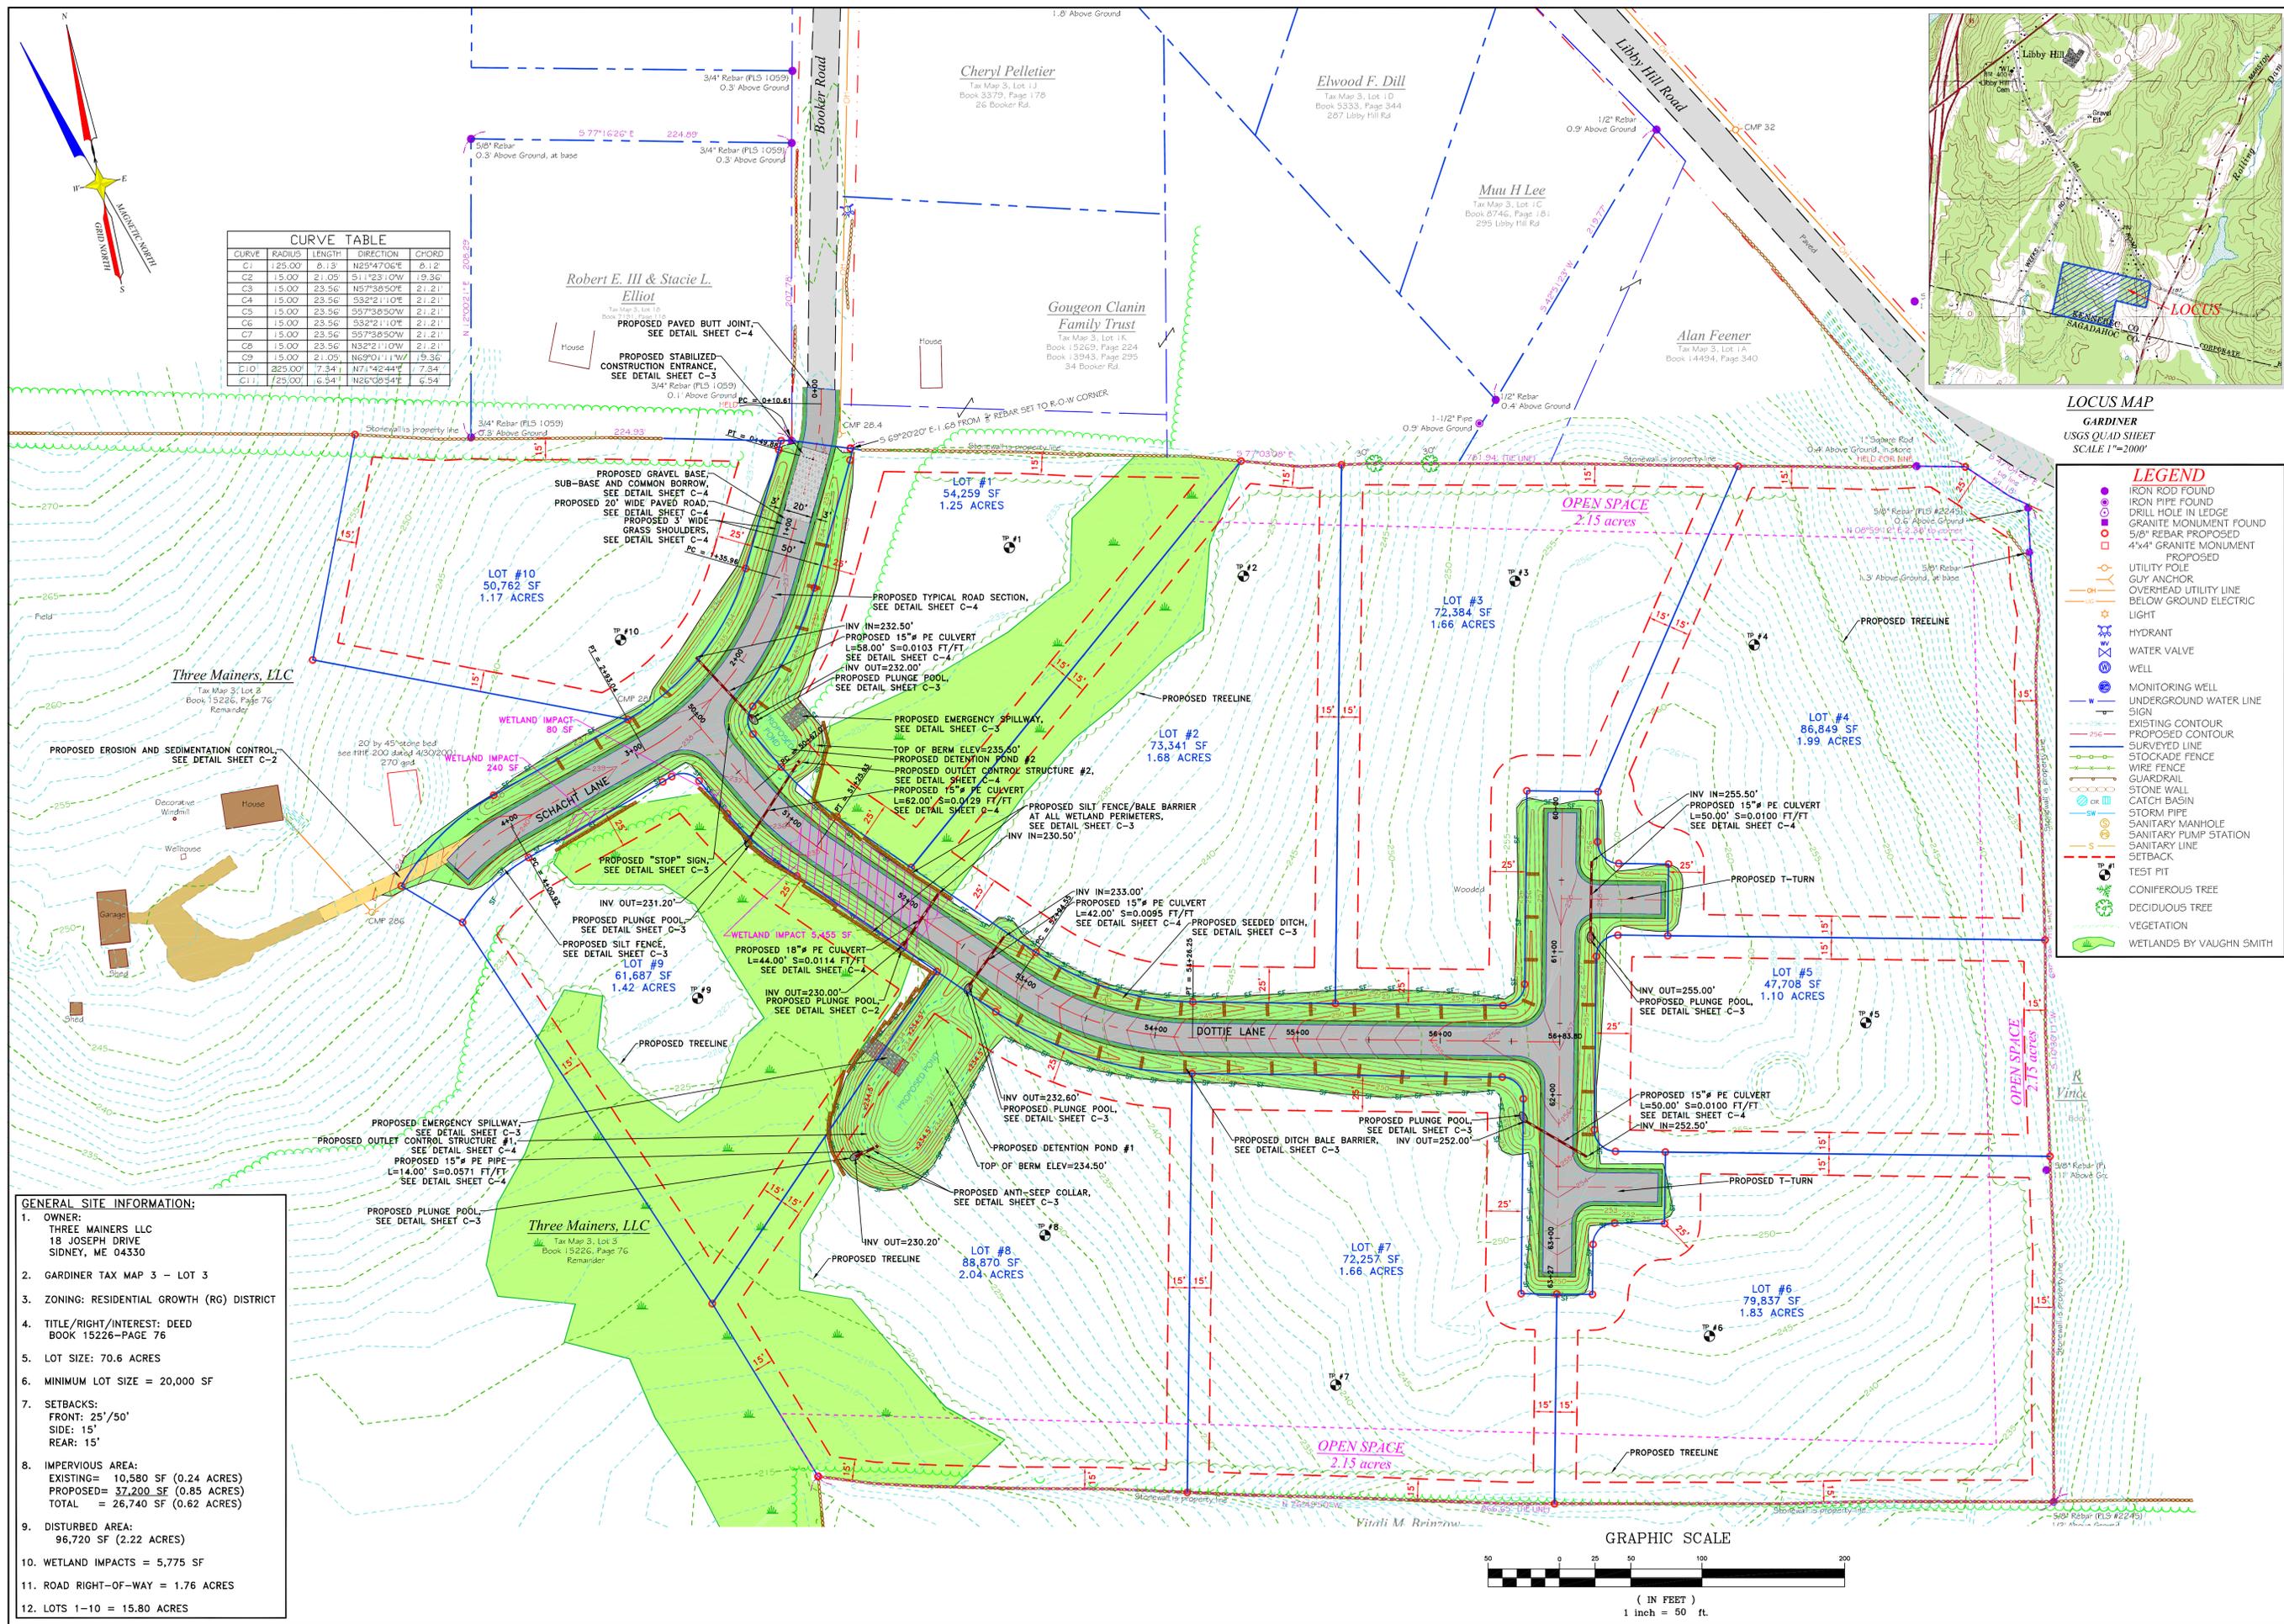

CURVE	RADIUS	LENGTH	DIRECTION	CHORD
C1	125.00	8.13	N25°47'06"E	81.22
C2	15.00	21.05	S11°23'10"W	19.36
C3	15.00	23.56	N57°38'50"E	21.21
C4	15.00	23.56	S32°21'10"E	21.21
C5	15.00	23.56	S57°38'50"W	21.21
C6	15.00	23.56	S32°21'10"E	21.21
C7	15.00	23.56	S57°38'50"W	21.21
C8	15.00	23.56	N32°21'10"W	21.21
C9	15.00	21.05	N69°01'11"W	19.36
C10	825.00	7.34	N71°42'44"E	7.34
C11	725.00	6.54	N26°08'54"E	6.54

LOT	AREA (SF)	ACRES
LOT #1	54,259	1.25
LOT #2	73,341	1.68
LOT #3	72,384	1.66
LOT #4	86,849	1.99
LOT #5	47,708	1.10
LOT #6	79,837	1.83
LOT #7	72,257	1.66
LOT #8	88,870	2.04
LOT #9	61,687	1.42
LOT #10	50,762	1.17

- GENERAL SITE INFORMATION:**
- OWNER:
THREE MAINERS LLC
18 JOSEPH DRIVE
SIDNEY, ME 04330
 - GARDINER TAX MAP 3 - LOT 3
 - ZONING: RESIDENTIAL GROWTH (RG) DISTRICT
 - TITLE/RIGHT/INTEREST: DEED
BOOK 15226-PAGE 76
 - LOT SIZE: 70.6 ACRES
 - MINIMUM LOT SIZE = 20,000 SF
 - SETBACKS:
FRONT: 25'/50'
SIDE: 15'
REAR: 15'
 - IMPERVIOUS AREA:
EXISTING= 10,580 SF (0.24 ACRES)
PROPOSED= 37,200 SF (0.85 ACRES)
TOTAL = 26,740 SF (0.62 ACRES)
 - DISTURBED AREA:
96,720 SF (2.22 ACRES)
 - WETLAND IMPACTS = 5,775 SF
 - ROAD RIGHT-OF-WAY = 1.76 ACRES
 - LOTS 1-10 = 15.80 ACRES

LEGEND

- IRON ROD FOUND
- IRON PIPE FOUND
- DRILL HOLE IN LEDGE
- GRANITE MONUMENT FOUND
- 5/8" REBAR PROPOSED
- 4"x4" GRANITE MONUMENT
- PROPOSED UTILITY POLE
- GUY ANCHOR
- OVERHEAD UTILITY LINE
- BELOW GROUND ELECTRIC
- LIGHT
- HYDRANT
- WATER VALVE
- WELL
- MONITORING WELL
- UNDERGROUND WATER LINE
- SIGN
- EXISTING CONTOUR
- PROPOSED CONTOUR
- SURVEYED LINE
- STOCKADE FENCE
- WIRE FENCE
- GUARDRAIL
- STONE WALL
- CATCH BASIN
- STORM PIPE
- SANITARY MANHOLE
- SANITARY PUMP STATION
- SANITARY LINE
- SETBACK
- TEST PIT
- CONIFEROUS TREE
- DECIDUOUS TREE
- VEGETATION
- WETLANDS BY VAUGHN SMITH


THIS PLAN PRELIMINARY
KANE P. COFFIN
#1297
REGISTERED PROFESSIONAL LAND SURVEYOR
WITHOUT SIGNATURE

E.S. COFFIN
LAND SURVEYING
432 Camp Road, Chelsea, Maine 04330
Phone (207) 653-9442 Fax (207) 653-9016

NO.	REVISIONS	DATE

SITE PLAN
SCALE: 1 INCH=50 FEET
DRAWN BY: TCH
CHECKED BY: JEC

CLIENT/PROJECT: **THREE MAINERS LLC SUNSET RIDGE SUBDIVISION**
LOCATION: **BOOKER ROAD**
TOWN: **GARDINER** COUNTY: **KENNEBEC** STATE: **MAINE**
PROJECT NO.: **2024-110**
C-1

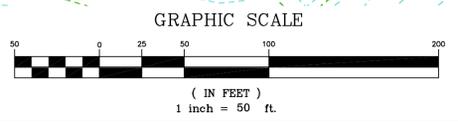

EROSION AND SEDIMENTATION NOTES:

1. CONTRACTOR SHALL FOLLOW BEST MANAGEMENT PRACTICES OF THE KENNEBEC COUNTY SOIL CONSERVATION SERVICE AND THE MAINE DEP BEST MANAGEMENT PRACTICES HANDBOOK.

GENERAL EROSION AND SEDIMENTATION CONTROL PRACTICES:

EROSION/SEDIMENT CONTROL DEVICES:

THE FOLLOWING EROSION SEDIMENTATION CONTROL DEVICES ARE PROPOSED FOR CONSTRUCTION ON THIS PROJECT. INSTALL THESE DEVICES AS INDICATED ON THE PLANS.

- SILT FENCE:** SILT FENCE WILL BE INSTALLED ALONG THE DOWN GRADING EDGES OF DISTURBED AREAS TO TRAP RUNOFF BORNE SEDIMENTS UNTIL THE SITE IS STABILIZED. IN AREAS WHERE STORMWATER DISCHARGES THE SILT FENCE WILL BE REINFORCED WITH HAY BALES TO HELP MAINTAIN THE INTEGRITY OF THE SILT FENCE AND TO PROVIDE ADDITIONAL TREATMENT.
- STONE CHECK DAMS:** STONE CHECK DAMS ARE TO BE PLACED IN LOW FLOW DRAINAGE SWALES AND PATHS TO TRAP SEDIMENTS AND REDUCE RUNOFF VELOCITIES. DO NOT PLACE STONE CHECK DAMS IN FLOWING WATER OR STREAMS.
- RIPRAP:** PROVIDE RIPRAP IN AREAS WHERE CULVERTS DISCHARGE OR AS SHOWN ON THE PLANS.
- LOAM, SEED, & MULCH:** ALL DISTURBED AREAS, WHICH ARE NOT OTHERWISE TREATED, SHALL RECEIVE PERMANENT SEEDING AND MULCH TO STABILIZE THE DISTURBED AREAS. THE DISTURBED AREAS WILL BE REVEGETATED WITHIN 5 DAYS OF FINAL GRADING. SEEDING REQUIREMENTS ARE PROVIDED ARE THE END OF THIS SPECIFICATION.
- STRAW AND HAY MULCH:** USED TO COVER DENUDED AREA UNTIL PERMANENT SEED OR EROSION CONTROL MEASURES ARE IN PLACE. MULCH BY ITSELF CAN BE USED ON SLOPES LESS THAN 15% IN SUMMER AND 8% IN WINTER. JUTE MESH IS TO BE USED OVER MULCH ONLY. CURLEX II AND EXCELSIOR MAY BE USED IN PLACE OF JUTE MESH OVER MULCH.
- MULCH NETTING:** SHALL BE USED TO ANCHOR MULCH IN ALL DRAINAGE WAYS WITH A SLOPE GREATER THAN 3% FOR SLOPES EXPOSED TO DIRECT WINDS AND FOR ALL OTHER SLOPES GREATER THAN 8%.

TEMPORARY EROSION/SEDIMENTATION CONTROL MEASURES:


PROVIDE THE FOLLOWING TEMPORARY EROSION/SEDIMENTATION CONTROL MEASURES DURING CONSTRUCTION OF THE DEVELOPMENT:

- SILTATION FENCE ALONG THE DOWN GRADIENT SIDE OF THE PARKING AREAS AND OF ALL FILL SECTIONS. THE SILTATION FENCE WILL REMAIN IN PLACE UNTIL THE SITE IS 85% REVEGETATED.
- HAY BALES PLACED AT KEY LOCATIONS TO SUPPLEMENT THE SILT FENCE.
- PROTECT TEMPORARY STOCKPILES OF STUMPS, GRUBBINGS, OR COMMON EXCAVATION AS FOLLOWS:
 - SOIL STOCKPILE SIDE SLOPES SHALL NOT EXCEED 2:1.
 - AVOID PLACING TEMPORARY STOCKPILES IN AREA WITH SLOPES OVER 10 PERCENT, OR NEAR DRAINAGE SWALES. SEE ITEM 3 IN CONSTRUCTION PHASE NOTES BELOW.
 - THE CONTRACTOR MUST STABILIZE SOIL AND FILL STOCKPILES WITHIN 7 DAYS PRIOR TO ANY RAINFALL.
 - SURROUND STOCKPILE SOIL WITH SILTATION FENCE AT BASE OF PILE.
- ALL DENUDED AREA WHICH HAVE BEEN ROUGH GRADED AND ARE NOTE LOCATED WITHIN THE BUILDING PAD, OR PARKING AND DRIVEWAY SUBBASE AREA SHALL RECEIVE MULCH WITHIN 7 DAYS OF INITIAL DISTURBANCE OF SOIL IN ANY AREA OR WITHIN 7 DAYS AFTER COMPLETING THE ROUGH GRADING OPERATIONS IN ANY AREA, OR PRIOR TO ANY RAINFALL. IN THE EVENT THE CONTRACTOR COMPLETES FINAL GRADING AND INSTALLATION OF LOAM AND SOD WITHIN THE TIME PERIODS PRESENTED ABOVE, INSTALLATION OF MULCH AND NETTING, WHERE APPLICABLE, IS NOT REQUIRED.
- IF WORK IS CONDUCTED BETWEEN OCTOBER 15 AND APRIL 15, ALL DENUDED AREAS ARE TO BE COVERED WITH HAY MULCH, APPLIED AT TWICE THE NORMAL APPLICATION RATE, AND ANCHORED WITH FABRIC NETTING. THE PERIOD BETWEEN FINAL GRADING AND MULCHING SHALL BE REDUCED TO A 1 DAY MAXIMUM FOR WORK COMPLETED BETWEEN OCTOBER 15TH AND APRIL 15TH.
- TEMPORARY EROSION CONTROL MEASURES SHALL BE REMOVED ONCE THE SITE HAS BEEN STABILIZED OR IN AREAS WHERE PERMANENT EROSION CONTROL MEASURES HAVE BEEN INSTALLED.

PERMANENT EROSION CONTROL MEASURES:

THE FOLLOWING PERMANENT CONTROL MEASURES ARE REQUIRED BY THIS EROSION/ SEDIMENTATION CONTROL PLAN:

- ALL AREAS DISTURBED DURING CONSTRUCTION, BUT NOT SUBJECT TO OTHER RESTORATION (PAVING, RIPRAP, ETC.), WILL BE LOAMED, LIMED, FERTILIZED AND SEEDED. NATIVE TOPSOIL SHALL BE STOCKPILED AND REUSED FOR FINAL RESTORATION WHEN IT IS OF SUFFICIENT QUALITY.
- SLOPES GREATER THAN 2:1 WILL RECEIVE RIPRAP.

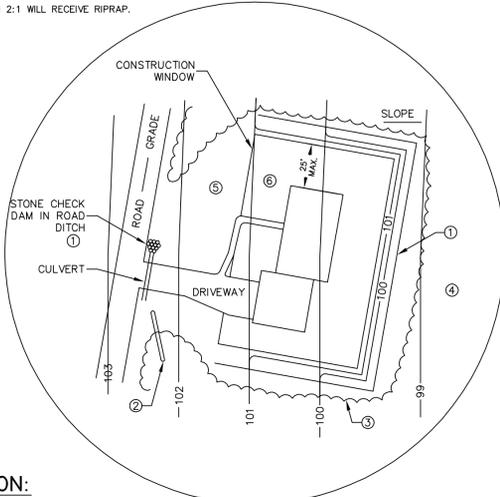

INSTALLATION:

- INSTALL SEDIMENT BARRIERS ON YOUR SITE BEFORE DISTURBING SOILS. SEE THE "SEDIMENT BARRIERS" MEASURE FOR DETAILS ON INSTALLATION AND MAINTENANCE.
- CONSTRUCT A DIVERSION DITCH TO KEEP UPSLOPE RUNOFF OUT OF WORK AREA.
- MARK CLEARING LIMITS ON THE SITE TO KEEP EQUIPMENT OUT OF AREAS WITH STEEP SLOPES, CHANNELIZED FLOW, OR ADJACENT SURFACE WATERS AND WETLANDS.
- PRESERVE BUFFERS BETWEEN THE WORK AREA AND ANY DOWNSTREAM SURFACE WATERS AND WETLANDS. SEE THE "BUFFERS" MEASURE FOR BUFFER PRESERVATION.
- USE TEMPORARY MULCH AND RYE--SEED TO PROTECT DISTURBED SOIL OUTSIDE THE ACTIVE CONSTRUCTION AREA. SEE THE "MULCHING" MEASURE AND "VEGETATION" MEASURE FOR DETAILS AND SPECIFICATIONS FOR THESE CONTROLS.
- PERMANENTLY SEED AREAS NOT TO BE PAVED WITHIN SEVEN DAYS OF COMPLETING FINAL GRADING. SEE "VEGETATION" MEASURE FOR INFORMATION ON PROPER SEEDING.

MAINTENANCE:

EVERY MONTH THE FIRST YEAR AFTER CONSTRUCTION AND YEARLY THEREAFTER, INSPECT FOR AREAS SHOWING EROSION OR POOR VEGETATION GROWTH. FIX THESE PROBLEMS AS SOON AS POSSIBLE. EACH SPRING REMOVE ANY ACCUMULATION OF DEBRIS OR WINTER SAND THAT WOULD IMPEDE RUNOFF FROM ENTERING A BUFFER OR DITCH.

HOUSE SITE - BEST MANAGEMENT PRACTICES

NOT TO SCALE

CONSTRUCTION PHASE:

THE FOLLOWING PRACTICES WILL BE USED TO PREVENT EROSION DURING CONSTRUCTION OF THIS PROJECT.

- ONLY THOSE AREAS UNDER ACTIVE CONSTRUCTION WILL BE CLEARED AND LEFT IN AN UNTREATED OR UNVEGETATED CONDITION. IF FINAL GRADING, LOAMING AND SEEDING WILL NOT OCCUR WITHIN 7 DAYS, SEE ITEM NO. 4.
- PRIOR TO THE START OF CONSTRUCTION IN A SPECIFIC ARE, SILT FENCING AND/OR HAY BALES WILL BE INSTALLED AT THE TOE OF SLOPE AND IN AREAS AS LOCATED ON THE PLANS T PROTECT AGAINST ANY CONSTRUCTION RELATED EROSION. IMMEDIATELY FOLLOWING CONSTRUCTION OF CULVERTS AND SWALES, RIP RAP APRONS SHALL BE INSTALLED, AS SHOWN ON THE PLANS.
- TOPSOIL WILL BE STOCKPILED WHEN NECESSARY IN AREAS WHICH HAVE MINIMUM POTENTIAL FOR EROSION AND WILL BE KEPT AS FAR AS POSSIBLE FROM THE EXISTING DRAINAGE COURSE. NO STOCKPILE SHALL BE CLOSER THEN 100' OF A RESOURCE INCLUDING, BUT NOT LIMITED TO, WETLANDS, STREAMS, AND OPEN WATER BODIES. ALL STOCKPILES SHALL HAVE A SILTATION FENCE BELOW THEM REGARDLESS OF TIME OF PRESENCE. ALL STOCKPILES EXPECTED TO REMAIN LONGER THAN 15 DAYS SHALL BE:
 - ALL STOCKPILES ANTICIPATED TO REMAIN IN PLACE FOR LESS THAN 30 DAYS SHALL BE TREATED WITH ANCHORED MUCH (WITHIN 5 DAYS OF THE LAST DEPOSIT OF STOCKPILED SOIL), OR PRIOR TO ANY RAINFALL OR COVERED WITH AND ANCHORED TARP WITHIN 7 DAYS OR PRIOR TO ANY RAINFALL.
 - ALL STOCKPILES ANTICIPATED TO REMAIN IN PLACE LONGER THAN 30 DAYS SHALL BE SEEDED WITH CONSERVATION MIX OF ANNUAL RYE GRASS (0.9 LB/1,000 SQ. FT.) AND MULCHED WITHIN 7 DAYS OR PRIOR TO ANY RAINFALL OR COVERED WITH AN ANCHORED TARP WITHIN 7 DAYS OR PRIOR TO ANY RAINFALL.
 - INSTALL SILT FENCE AROUND STOCKPILE AT BASE OF PILE, STOCKPILES TO HAVE SILT FENCE INSTALLED AT TIME ESTABLISHMENT AT BASE OF PILE.
- DISTURBED AREAS:
 - DISTURBED AREAS ANTICIPATED REMAINING UNDISTURBED FOR LESS THAN 30 DAYS UNTIL PERMANENTLY STABILIZED SHALL BE TREATED WITH ANCHORED MULCH WITHIN 7 DAYS OR PRIOR TO ANY RAINFALL.
 - DISTURBED AREAS ANTICIPATED TO REMAIN UNDISTURBED FOR MORE THAN 30 DAYS UNTIL PERMANENTLY STABILIZED SHALL BE TREATED SEEDED WITH CONSERVATION MIX OF ANNUAL RYE GRASS (0.9 LBS/1,000 SQ. FT.) AND MULCHED AT A RATE OF 150 LB. PER 1000 S.F. WITHIN 7 DAYS OR PRIOR TO ANY RAINFALL.
- ALL GRADING WILL BE HELD TO A MAXIMUM 2:1 SLOPE WHERE PRACTICAL. ALL SLOPES WILL BE STABILIZED WITH PERMANENT SEEDING, OR WITH STONE, WITHIN 5 DAYS AFTER FINAL GRADING IS COMPLETE. (SEE POST-CONSTRUCTION REVEGETATION FOR SEEDING SPECIFICATION.) ALL SLOPES HAVING A GRADE GREATER THAN 8% WILL BE STABILIZED WITH RIP RAP OR PERMANENT SEEDING WITHIN 5 DAYS OF COMPLETING THE SLOPES FINAL GRADING.
- THE CONTRACTOR SHALL WITHIN 24 HOURS OF PLACING A CULVERT PLACE STONE RIP RAP, APRON OR PLUNGE POOL, AT THE CULVERTS OUTLET. ALL CULVERTS WILL BE PROTECTED WITH STONE RIP RAP (D50 = 6" UNLESS OTHERWISE SPECIFIED) AT INLETS AND OUTLETS.
- ANY DITCH SECTION BROUGHT TO FINAL GRADE WILL BE STABILIZED WITH RIP RAP LINED OR PROPERLY INSTALLED EROSION CONTROL BLANKETS (USED OVER PERMANENT SEEDING) WITHIN 5 DAYS.

POST-CONSTRUCTION REVEGETATION:

THE FOLLOWING GENERAL PRACTICES WILL BE USED TO PREVENT EROSION AS SOON AS AN AREA IS READY TO UNDERGO FINAL GRADING.

- A MINIMUM OF 4" OF LOAM WILL BE SPREAD OVER DISTURBED AREAS AND GRADED TO A UNIFORM DEPTH AND NATURAL APPEARANCE, OR STONE WILL BE PLACED ON SLOPES TO STABILIZE SURFACES.
- IF FINAL GRADING IS REACHED DURING THE NORMAL GROWING SEASON (4/15 TO 9/15), PERMANENT SEEDING WILL BE DONE AS SPECIFIED BELOW. PRIOR TO SEEDING, LIMESTONE SHALL BE APPLIED AT A RATE OF 138 LBS/1,000 SQ. FT. AND 10:20:20 FERTILIZER AT A RATE OF 18.4 LBS/1,000 SQ. FT. WILL BE APPLIED. BROADCAST SEEDING AT THE FOLLOWING RATES:

LAWNS
 KENTUCKY BLUEGRASS 0.46 LBS/1,000 S.F.
 CREEPING RED FESCUE 0.46 LBS/1,000 S.F.
 PERENNIAL RYE GRASS 0.11 LBS/1,000 S.F.

SWALES
 RED TOP 0.05 LBS/1,000 S.F.
 TALL FESCUE 0.46 LBS/1,000 S.F.
- AN AREA SHALL BE MULCHED IMMEDIATELY AFTER IS HAS BEEN SEEDED. MULCHING SHALL CONSIST OF HAY MULCH, HYDRO-MULCH, JUTE NET OVER MULCH, PRE-MANUFACTURED EROSION MATS OR ANY SUITABLE SUBSTITUTE DEEMED ACCEPTABLE BY THE DESIGNER.
 - HAY MULCH SHALL BE APPLIED AT THE RATE OF 2 TONS PER ACRE. HAY MULCH SHALL BE SECURED BY EITHER: (NOTE: SOIL SHALL NOT BE VISIBLE)
 - BEING DRIVEN OVER BY TRACKED CONSTRUCTION EQUIPMENT ON GRADES OF 5% AND LESS.
 - BLANKETED BY TACKED PHOTODEGRADABLE/BIODEGRADABLE NETTING, OR WITH SPRAY, ON GRADES GREATER THAN 5%.
 - SEE NOTE 6, GENERAL NOTES, AND NOTE 8, WINTER CONSTRUCTION.
- HYDRO-MULCH SHALL CONSIST OF A MIXTURE OF EITHER ASPHALT, WOOD FIBER OR PAPER FIBER AND WATER SPRAYED OVER A SEEDED AREA. HYDRO-MULCH SHALL NOT BE USED BETWEEN 9/15 AND 4/15.
- CONSTRUCTION SHALL BE PLANNED TO ELIMINATE THE NEED FOR SEEDING BETWEEN SEPTEMBER 15 AND APRIL 15. SHOULD SEEDING BE NECESSARY BETWEEN SEPTEMBER 15 AND APRIL 15 THE FOLLOWING PROCEDURE SHALL BE FOLLOWED. ALSO REFER TO NOTE 9 OF WINTER CONSTRUCTION.
 - ONLY UNFROZEN LOAM SHALL BE USED.
 - LOAMING, SEEDING AND MULCHING WILL NOT BE DONE OVER SNOW OR ICE COVER. IF SNOW EXISTS, IT MUST BE REMOVED PRIOR TO PLACEMENT OF SEED.
 - WHERE PERMANENT SEEDING IS NECESSARY, ANNUAL WINTER RYE (1.2 LBS/1,000 SQ. FT.) SHALL BE ADDED TO THE PREVIOUSLY NOTED AREAS.
 - WHERE TEMPORARY SEEDING IS REQUIRED, ANNUAL WINTER RYE (2.6 LBS/1,000 SQ.FT.) SHALL BE SOWN INSTEAD OF THE PREVIOUSLY NOTED SEEDING RATE.
 - FERTILIZING, SEEDING AND MULCHING SHALL BE APPLIED TO LOAM THE DAY THE LOAM IS SPREAD BY MACHINERY.
 - ALTERNATIVE HAY MULCH SHALL BE SECURED WITH PHOTODEGRADABLE/BIODEGRADABLE NETTING. TRACKING BY MACHINERY ALONE WILL NOT SUFFICE.
- FOLLOWING FINAL SEEDING, THE SITE WILL BE INSPECTED EVERY 30 DAYS UNTIL 85% COVER HAS BEEN ESTABLISHED. THE CONTRACTOR WILL CARRY OUT RESEEDING WITHIN 10 DAYS OF NOTIFICATION BY THE ENGINEER THAT THE EXISTING CATCH IS INADEQUATE.

MONITORING SCHEDULE:

THE CONTRACTOR IS RESPONSIBLE FOR INSTALLING, MONITORING, MAINTAINING, REPAIRING, REPLACING AND REMOVING ALL OF THE EROSION AND SEDIMENTATION CONTROLS OR APPOINTING A QUALIFIED SUBCONTRACTOR TO DO SO. MAINTENANCE MEASURES WILL BE APPLIED AS NEEDED DURING THE ENTIRE CONSTRUCTION CYCLE. AFTER EACH RAINFALL, A VISUAL INSPECTION WILL BE MADE OF ALL EROSION AND SEDIMENTATION CONTROLS AS FOLLOWS:

- HAY BALE BARRIERS, SILT FENCE, AND STONE CHECK DAMS SHALL BE INSPECTED AND REPAIRED ONCE A WEEK OR IMMEDIATELY FOLLOWING ANY SIGNIFICANT RAINFALL. SEDIMENT TRAPPED BEHIND THESE BARRIERS SHALL BE EXCAVATED WHEN IT REACHES A DEPTH OF 6" AND REDISTRIBUTED TO AREA UNDERGOING FINAL GRADING. SHOULD THE HAY BALE BARRIERS PROVE TO BE INEFFECTIVE, THE CONTRACTOR SHALL INSTALL SILT FENCE BEHIND THE HAY BALES.
- VISUALLY INSPECT RIP RAP ONCE A WEEK OR AFTER EACH SIGNIFICANT RAINFALL AND REPAIR AS NEEDED. REMOVE SEDIMENT TRAPPED BEHIND THESE DEVICES ONCE IT ATTAINS A DEPTH EQUAL TO 1/2 THE HEIGHT OF THE DAM OR RISER. DISTRIBUTE REMOVED SEDIMENT OFF-SITE OR TO AN AREA UNDERGOING FINAL GRADING.
- REVEGETATION OF DISTURBED AREAS WITHIN 25' OF DRAINAGE-COURSE/STREAM WILL BE SEEDED WITH THE "MEADOW AREA MIX" AND INSPECTED ON A WEEKLY BASIS OR AFTER EACH SIGNIFICANT RAINFALL AND RESEEDED AS NEEDED. EXPOSED AREAS WILL BE RESEEDD AS NEEDED UNTIL THE AREA HAS OBTAINED 100% GROWTH RATE. PROVIDE PERMANENT RIP RAP FOR SLOPES IN EXCESS OF 3:1 AND WITHIN 25' OF DRAINAGE COURSE.

EROSION CONTROL DURING WINTER CONSTRUCTION:


- WINTER CONSTRUCTION PRIOR: NOVEMBER 1 THROUGH APRIL 15.
- WINTER EXCAVATION AND EARTHWORK SHALL BE COMPLETED SUCH THAT NO MORE THAN 1 ACRE OF THE SITE IS WITHOUT STABILIZATION AT ANY ONE TIME.
- EXPOSED AREA SHALL BE LIMITED TO THOSE AREAS TO BE MULCHED IN ONE DAY PRIOR TO ANY SNOW EVENT. ATE END OF EACH WORK WEEK NO AREAS MAY BE LEFT UNSTABILIZED OVER THE WEEKEND.
- CONTINUATION OF EARTHWORK OPERATIONS ON ADDITIONAL AREAS SHALL NOT BEGN UNTIL THE EXPOSED SOIL SURFACE ON THE AREA BEING WORKED HAS BEEN STABILIZED, SUCH TAT NO LARGER AREA OF THE SITE IS WITHOUT EROSION CONTROL PROTECTION AS LISTED IN ITEM 2 ABOVE.
- AN AREA SHALL BE CONSIDERED TO HAVE BEEN STABILIZED WHEN EXPOSED SURFACES HAVE BEEN EITHER MULCHED WITH STRAW OR HAY AT A RATE OF 150 LB. PER 1,000 B.F. (WITH OR WITHOUT SEEDING) OR DORMANT SEEDED, MULCHED AND ANCHORED SUCH TAT SOIL SURFACE IS NOT VISIBLE THROUGH THEY MULCH. NOTE: AN AREA TO BE USED AS A ROAD OR VEHICLE PARKING LOT IS ALSO CONSIDERED STABLE IF SODDED, COVERED WITH COMPACTED GRAVEL SUBBASE OR COMPACTED STRUCTURAL SAND.
- BETWEEN THE DATES OF OCTOBER 15 AND APRIL 1, LOAM OR SEED WILL NOT BE REQUIRED, DURING PERIODS OF ABOVE FREEZING TEMPERATURES THE SLOPES SHALL BE FINE GRADED AND EITHER PROTECTED WITH MULCH OR TEMPORARILY SEEDED AND MULCHED UNTIL SUCH TIME AS THE FINAL TREATMENT CAN BE APPLIED. IF THE DATE IS AFTER NOVEMBER 1 AND IF THE EXPOSED AREA HAS BEEN LOAMED, FINAL GRADED WITH A UNIFORM SURFACE, THEN THE AREA MAY BE DORMANT SEEDED AT A RATE OF 3 TIMES HIGHER THAN SPECIFIED FOR PERMANENT SEED AND THEN MULCHED. IF CONSTRUCTION CONTINUES DURING FREEZING WEATHER, ALL EXPOSED AREAS SHALL BE CONTINUOUSLY GRADED BEFORE FREEZING AND THE SURFACE TEMPORARILY PROTECTED FROM EROSION BY THE APPLICATION OF MULCH. SLOPES SHALL NOT BE LEFT UNEXPOSED OVER THE WINTER OR ANY OTHER EXTENDED TIME OF WORK SUSPENSION UNLESS TREATED IN THE ABOVE MANNER. UNTIL SUCH TIME AS EITHER CONDITIONS ALLOW, DITCHES TO BE FINISHED WITH THE PERMANENT SURFACE TREATMENT, EROSION SHALL BE CONTROLLED BY THE INSTALLATION OF BALES OF HAY, SILT FENCE OR STONE CHECK DAMS IN ACCORDANCE WITH THE STANDARD DETAILS SHOWN ON THE DESIGN DRAWINGS. NOTE: DORMANT SEEDING SHOULD NOT BE ATTEMPTED UNLESS SOIL TEMPERATURE REMAINS ABOVE 50 DEGREES AND DAY TIME TEMPERATURES REMAIN IN THE 30'S.
- MULCH NETTING SHALL BE USED TO ANCHOR MULCH IN ALL DRAINAGE WAYS WITH A SLOPE GREATER THAN 3% FOR SLOPES EXPOSED TO DIRECT WINDS AND FOR ALL OTHER SLOPES GREATER THAN 8% VEGETATED DRAINAGE SWALES SHALL BE LINED WITH EXCELSIOR OR CURLEX.
- MULCH NETTING SHALL BE USED TO ANCHOR MULCH IN ALL DRAINAGE WAYS WITH SLOPES GREATER THAN 15%. AFTER OCTOBER 1 THE SAME APPLIES FOR ALL SLOPES GREATER THAN 8%.
- WINTER RYE IS RECOMMENDED FOR STABILIZATION UNTIL OCTOBER 1ST. AFTER OCTOBER 1, WINTER RYE IS NOT EFFECTIVE. AROUND NOVEMBER 15 OR LATER, ONCE TEMPERATURES OF THE AIR AND SOIL PERMIT, DORMANT SEEDING IS EFFECTIVE.
- IN THE EVENT OF SNOWFALL (FRESH OR CUMULATIVE) GREATER THAN 1 INCH DURING WINTER CONSTRUCTION PERIOD ALL SNOW SHALL BE REMOVED FROM THE AREAS OF SEEDING AND MULCHING PRIOR TO PLACEMENT.

GUIDELINES FOR STABILIZING SITES FOR THE WINTER:

- STANDARD FOR THE TIMELY STABILIZATION OF DITCHES AND CHANNELS. THE CONTRACTOR WILL CONSTRUCT AND STABILIZE ALL STONE-LINED DITCHES AND CHANNELS ON THE SITE BY NOVEMBER 15TH. THE CONTRACTOR WILL CONSTRUCTION AND STABILIZE ALL GRASS-LINED DITCHES AND CHANNELS ON THE SITE BY SEPTEMBER 1ST. IF THE CONTRACTOR FAILS TO STABILIZE A DITCH OR CHANNEL TO BE GRASS-LINED BY SEPTEMBER 1ST, THEN THE CONTRACTOR WILL TAKE ONE OF THE FOLLOWING ACTIONS TO STABILIZE THE DITCH FOR LATE FALL AND WINTER.
 - INSTALL A SOD LINING IN THE DITCH: THE CONTRACTOR WILL LINE THE DITCH WITH PROPERLY INSTALLED SOD BY OCTOBER 1ST. PROPER INSTALLATION INCLUDES THE CONTRACTOR PINNING THE SOD ONTO THE SOIL WITH WIRE PINS, ROLLING THE SOD TO GUARANTEE CONTACT BETWEEN THE SOD AND UNDERLYING SOIL, WATERING THE SOD TO PROMOTE ROOT GROWTH INTO THE DISTURBED SOIL, AND ANCHORING SOD AT THE BASE OF THE DITCH WITH JUTE OR PLASTIC MESH TO PREVENT THE SOD FROM SLOUGHING DURING FLOW CONDITIONS.
 - INSTALL A STONE LINING IN THE DITCH: THE CONTRACTOR WILL LINE THE DITCH WITH STONE RIP RAP BY NOVEMBER 15TH. THE DEVELOPMENT'S OWNER WILL HIRE A REGISTERED PROFESSIONAL ENGINEER TO DETERMINE THE STONE SIZE AND LINE THICKNESS NEEDED TO WITHSTAND THE ANTICIPATED FLOW VELOCITIES AND FLOW DEPTHS WITHIN THE DITCH. IF NECESSARY, THE CONTRACTOR WILL REGRADE THE DITCH PRIOR TO PLACING THE STONE LINING SO AS TO PREVENT THE STONE LINING FORM REDUCING THE DITCH'S CROSS-SECTIONAL AREA.
- STANDARD FOR THE TIMELY STABILIZATION OF DISTURBED SLOPES: THE CONTRACTOR WILL CONSTRUCT AND STABILIZE STONE COVERED SLOPES BY NOVEMBER 15. THE CONTRACTOR WILL SEED AND MULCH ALL SLOPES TO BE VEGETATED BY SEPTEMBER 1. THE DEPARTMENT WILL CONSIDER ANY AREA HAVING A GRADE GREATER THAN 15% TO BE A SLOPE. IF THE CONTRACTOR FAILS TO STABILIZE ANY SLOPE TO BE VEGETATED BY SEPTEMBER 15, THEN THE CONTRACTOR WILL TAKE ONE OF THE FOLLOWING ACTIONS TO STABILIZE THE SLOPE FOR LATE FALL AND WINTER.
 - STABILIZE THE SOIL WITH TEMPORARY VEGETATION AND EROSION CONTROL MATS BY OCTOBER 1 THE CONTRACTOR WILL SEED THE DISTURBED SLOPE WITH WINTER RYE AT A SEEDING RATE OF 3 POUNDS PER 1,000 SQUARE FEET AND THEN INSTALL EROSION CONTROL MATS OR ANCHORED MULCH OVER THE SEEDING. THE CONTRACTOR WILL MONITOR GROWTH OF THE RYE OVER THE NEXT 30 DAYS. IF THE RYE FAILS TO GROW AT LEAST THREE INCHES OR FAILS TO COVER AT LEAST 75% OF THE SLOPE BY NOVEMBER 1, THEN THE CONTRACTOR WILL COVER THE SLOPE WITH A LAYER OF WOOD--WASTE COMPOST AS DESCRIBED IN ITEM 3 OF THIS STANDARD OR WITH STONE RIP RAP AS DESCRIBED IN ITEM 4 OF THIS STANDARD.
 - STABILIZE THE SLOPE WITH SOD: THE CONTRACTOR WILL STABILIZE THE DISTURBED SLOPE WITH PROPERLY INSTALLED SOD BY OCTOBER 1. PROPER INSTALLATION INCLUDES THE CONTRACTOR PINNING THE SOD ONTO THE SLOPE WITH WIRE PINS, ROLLING THE SOD TO GUARANTEE CONTACT BETWEEN THE SOD AND UNDERLYING SOIL, AND WATERING THE SOD TO PROMOTE ROOT GROWTH INTO THE DISTURBED SOIL. THE CONTRACTOR WILL NOT USE LATE-SEASON SOD INSTALLATION TO STABILIZE SLOPES HAVING A GRADE GREATER THAN 33% (3H:1V) OR HAVING GROUNDWATER SEEPS ON THE SLOPE FACE.
 - STABILIZE THE SLOPE WITH WOOD--WASTE COMPOST: THE CONTRACTOR WILL PLACE A SIX-INCH LAYER OF WOOD--WASTE COMPOST ON THE SLOPE BY NOVEMBER 15. THE CONTRACTOR WILL NOT USE WOOD--WASTE COMPOST TO STABILIZE SLOPES HAVING GRADES GREATER THAN 50% (2H: 1V) OR HAVING GROUNDWATER SEEPS ON THE SLOPE FACE.
 - STABILIZE THE SLOPE WITH STONE RIP RAP: THE CONTRACTOR WILL PLACE A LAYER OF STONE RIP RAP ON THE SLOPE BY NOVEMBER 15. THE DEVELOPMENT'S OWNER WILL HIRE A REGISTERED PROFESSIONAL ENGINEER TO DETERMINE THE STONE SIZE NEEDED FOR STABILITY ON THE SLOPE AND TO DESIGN A FILTER LAYER FOR UNDERNEATH THE RIP RAP.
- STANDARD FOR THE TIMELY STABILIZATION OF DISTURBED SOILS: BY SEPTEMBER 15 THE CONTRACTOR WILL SEED AND MULCH ALL DISTURBED SOILS ON THE SITE. IF THE CONTRACTOR FAILS TO STABILIZE THESE SOILS BY THIS DATE, THEN THE CONTRACTOR WILL TAKE ONE OF THE FOLLOWING ACTIONS TO STABILIZE THE SOIL FOR LATE FALL AND WINTER.
 - STABILIZE THE SOIL WITH TEMPORARY VEGETATION: BY OCTOBER 1 THE CONTRACTOR WILL SEED THE DISTURBED SOIL WITH WINTER RYE AT A SEEDING RATE OF 3 POUNDS PER 1,000 SQUARE FEET, LIGHTLY MULCH THE SEEDED SOIL WITH HAY OR STRAW AT 75 POUNDS PER 1,000 SQUARE FEET, AND ANCHOR THE MULCH WITH PLASTIC NETTING THE CONTRACTOR WILL MONITOR GROWTH OF THE RYE OVER THE NEXT 30 DAYS. IF THE RYE FAILS TO GROW AT LEAST THREE INCHES OR FAILS T COVER AT LEAST 75% OF THE DISTURBED SOIL BEFORE NOVEMBER 1, THEN THE CONTRACTOR WILL MULCH THE AREA FOR OVER PROTECTION AS DESCRIBED IN ITEM 3 OF THIS STANDARD.
 - STABILIZE THE SOIL WITH SOD: THE CONTRACTOR WILL STABILIZE THE DISTURBED SOIL WITH PROPERLY INSTALLED SOD BY OCTOBER 1. PROPER INSTALLATION INCLUDES THE CONTRACTOR PINNING THE SOD ONTO THE SOIL WITH WIRE PINS, ROLLING THE SOD TO GUARANTEE CONTACT BETWEEN THE SOD AND UNDERLYING SOIL, AND WATERING THE SOD TO PRONTO ROOT GROWTH INTO THE DISTURBED SOIL.
 - STABILIZE THE SOIL WITH MULCH: BY NOVEMBER 15 THE CONTRACTOR WILL MULCH THE DISTURBED SOIL BY SPREADING HAY OR STRAW AT A RATE OF AT LEAST 150 POUNDS PER 1,000 SQUARE FEET ON THE AREA SO THAT NO SOIL IS VISIBLE THROUGH THE MULCH. IMMEDIATELY AFTER APPLYING THE MULCH, THE CONTRACTOR WILL ANCHOR THE MULCH WITH NETTING OR OTHER METHOD TO PREVENT WIND FROM MOVING THE MULCH OFF THE DISTURBED SOIL.

SITE INSPECTION AND MAINTENANCE:

- WEEKLY INSPECTIONS, AS WELL AS ROUTINE INSPECTIONS FOLLOWING RAIN FALLS, SHALL BE CONDUCTED BY GENERAL CONTRACTOR OF ALL TEMPORARY AND PERMANENT EROSION CONTROL DEVICES UNTIL FINAL ACCEPTANCE OF THE PROJECT (85% GRASS CATCH). NECESSARY REPAIRS SHALL BE MADE TO CORRECT UNDERMINING OR DETERIORATION. FINAL ACCEPTANCE SHALL INCLUDE A SITE INSPECTION TO VERIFY THE STABILITY OF ALL DISTURBED AREAS AND SLOPES. UNTIL FINAL INSPECTION, ALL EROSION AND SEDIMENTATION CONTROL MEASURES SHALL IMMEDIATELY BE CLEARED, AND REPAIRED BY THE GENERAL CONTRACTOR AS REQUIRED. DISPOSAL OF ALL TEMPORARY EROSION AND CONTROL DEVICES SHALL BE THE RESPONSIBILITY OF THE GENERAL CONTRACTOR.
- IT IS RECOMMENDED THAT THE OWNER HIRE THE SERVICES OF THE DESIGN ENGINEER TO PROVIDE COMPLIANCE INSPECTIONS (DURING ACTIVE CONSTRUCTION) RELATIVE TO IMPLEMENTATION OF THE STORMWATER AND EROSION CONTROL PLANS. SUCH INSPECTIONS SHOULD BE LIMITED TO ONCE A WEEK OR AS NECESSARY AND BE REPORTABLE TO THE OWNER, TOWN AND DEP.
- SHORT-TERM SEDIMENTATION MAINTENANCE SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO CLEAN OUT ALL SWALES AND STRUCTURES PRIOR TO TURNING PROJECT OVER.
- LONG-TERM PROVISIONS FOR PERMANENT MAINTENANCE OF ALL EROSION AND SEDIMENTATION CONTROL DEVICES AFTER ACCEPTANCE OF THE PROJECT SHALL BE THE RESPONSIBILITY OF THE OWNER, TOWN OR THEIR DESIGNEE.



NO.	REVISIONS	DATE

SITE DETAILS I

SHEET TITLE:

SCALE: AS SHOWN

DATE: JANUARY 22, 2026

DRAWN BY: TCH

CHECKED BY: JEC


CLIENT/PROJECT: **THREE MAINERS LLC**

LOCATION: **BOOKER ROAD**

TOWN: **GARDNER** COUNTY: **KENNEBEC** STATE: **MAINE**

PROJ. NO. **2024-110**

C-2

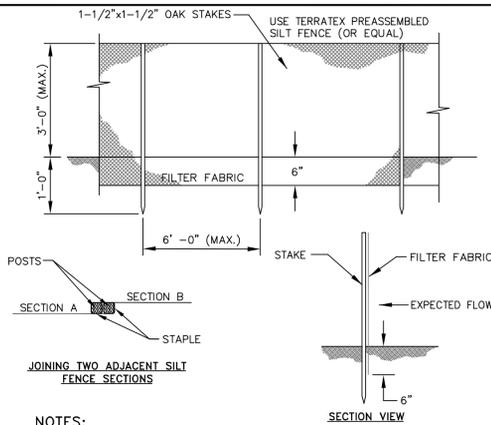


NOTES:
SILT FENCE AND FILTER BARRIERS SHALL BE INSPECTED IMMEDIATELY AFTER EACH RAINFALL AND AT LEAST DAILY DURING PROLONGED RAINFALL. ANY REQUIRED REPAIRS SHALL BE MADE IMMEDIATELY.

SHOULD THE FABRIC ON A SILT FENCE OR FILTER BARRIER DECOMPOSE OR BECOME INEFFECTIVE PRIOR TO THE END OF THE EXPECTED USABLE LIFE AND THE BARRIER STILL IS NECESSARY, THE FABRIC SHALL BE REPLACED PROMPTLY.

SEDIMENT DEPOSITS SHALL BE REMOVED AFTER EACH STORM EVENT. THEY MUST BE REMOVED WHEN DEPOSITS REACH APPROXIMATELY ONE-HALF THE HEIGHT OF THE BARRIER. ANY SEDIMENT DEPOSITS REMAINING IN PLACE AFTER THE SILT FENCE OR FILTER BARRIER IS NO LONGER REQUIRED SHALL BE DRESSED TO CONFORM WITH THE EXISTING GRADE, PREPARED AND SEEDED.

THE TRENCH SHALL BE BACKFILLED AND THE SOIL COMPACTED OVER THE FILTER FABRIC. SILT FENCES SHALL BE REMOVED WHEN THEY HAVE SERVED THEIR USEFUL PURPOSE, BUT NOT BEFORE THE UPSLOPE AREA HAS BEEN PERMANENTLY STABILIZED.

SILT FENCE DETAIL
NOT TO SCALE

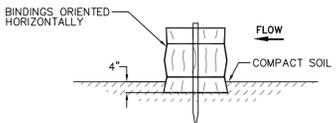


MAINTENANCE


- THE BARRIERS SHALL BE INSPECTED IMMEDIATELY AFTER EACH RAINFALL AND AT LEAST DAILY DURING PROLONGED RAINFALL.
- CLOSE ATTENTION SHALL BE PAID TO THE REPAIR OF DAMAGED BALES, END RUNS AND UNDERCUTTING BENEATH BALES.
- NECESSARY REPAIRS TO BARRIERS OR REPLACEMENT SHALL BE ACCOMPLISHED PROMPTLY.
- SEDIMENT DEPOSITS SHOULD BE REMOVED AFTER EACH RAINFALL. THEY MUST BE REMOVED WHEN THE LEVEL OF DEPOSITION REACHES APPROXIMATELY ONE HALF THE HEIGHT OF THE BARRIER. THEY MUST BE REMOVED WHEN THE BARRIER IS REMOVED.

NOTES:
- BALES ARE HAY OR STRAW, DIMENSIONS: 14" x 18" x 30", WIRE OR NYLON, PLACED IN DRAINAGE AREAS, UPON THE CONTOUR OF THE GROUND. BALES ARE TO BE PLACED IN A ROW, WITH ENDS TIGHTLY SET AGAINST THE ADJACENT BALE.


- EACH BALE IS TO BE EMBEDDED IN THE SOIL A MINIMUM OF 4" AND ANCHORED IN PLACE BY STAKES DRIVEN THROUGH THE BALES INTO THE GROUND AT LEAST 18". THE STAKES ARE TO BE DRIVEN IN SUCH A MANNER AS TO FORCE THE ENDS OF THE BALES TOGETHER. STAKES MAY BE REBAR STEEL PICKETS, 2" x 2" SOFTWOOD, OR 1" x 1" HARDWOOD.




BALE BARRIER
NOT TO SCALE

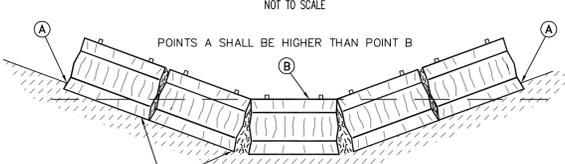

DITCH BALE BARRIER
NOT TO SCALE

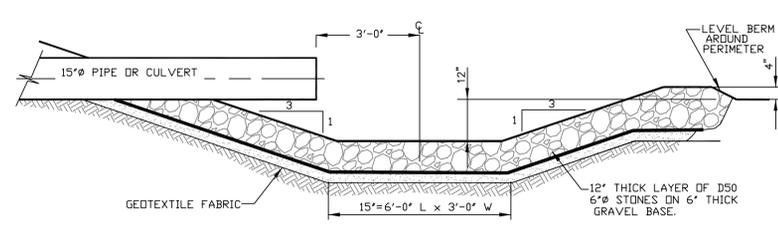

PLUNGE POOL SECTION
NOT TO SCALE

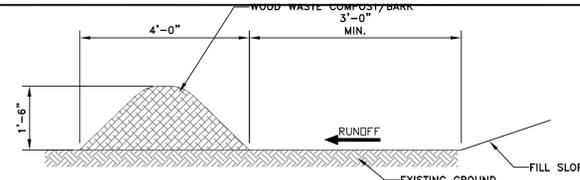

WOOD WASTE COMPOST/BARK FILTER BERMS

THE FILTER BERM SHALL CONSIST OF A WOOD WASTE COMPOST/BARK MULCH MIX OR RECYCLED COMPOSTED BARK FLUME GRIT AND FRAGMENTED WOOD GENERATED FROM WATER-FLUME LOG HANDLING SYSTEMS. COMPOSTED MIXES CAN BE USED UPON APPROVAL OF THE OFFICE OF ENVIRONMENTAL SERVICES LANDSCAPE UNIT.


THE MIX SHALL CONFORM TO THE FOLLOWING STANDARDS:

- MOISTURE CONTENT - 30-60%
- pH - 5.0-8.0
- SCREEN SIZE - 100% LESS THAN 3", MAXIMUM 70% LESS THAN 1"
- NO LESS THAN 40% ORGANIC MATERIAL (DRY WEIGHT) BY LOSS OF IGNITION
- NO STONES LARGER THAN 2" IN DIAMETER

THE COMPOSTED BERM SHALL BE PLACED, UNCOMPACTED, ALONG A RELATIVELY LEVEL CONTOUR.


NOTE:
WOOD WASTE COMPOST/BARK FILTER BERMS MAY BE USED IN COMBINATION WITH SILT FENCE TO IMPROVE SEDIMENT REMOVAL AND PREVENT CLOGGING OF THE WOOD WASTE COMPOST/BARK BERM BY LARGER SEDIMENT PARTICLES. (SILT FENCE PLACED TO FILTER RUNOFF BEFORE WOOD WASTE COMPOST/BARK)

WOOD WASTE COMPOST/BARK FILTER BERM ALTERNATIVE
NOT TO SCALE

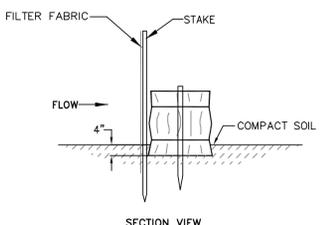


SILT FENCE/BALE BARRIER DETAIL
NOT TO SCALE

NOTES:
ANY SEDIMENT BARRIERS LOCATED AT LOW POINTS OR SUBJECT TO PONDING ALONG THE FENCE SHALL BE REINFORCED AS SHOWN ABOVE WITH A COMBINATION OF HAY/BALES & SILT FENCE. THE CONTRACTOR SHALL REMOVE SEDIMENT TRAPPED AT THESE LOW POINTS AFTER EVERY STORM EVENT.

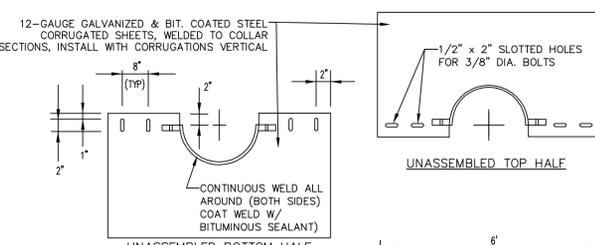


ANTI-SEEP COLLAR DETAIL
NOT TO SCALE

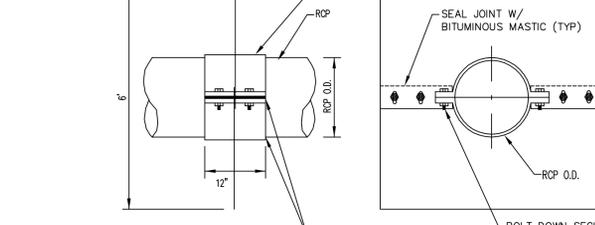

2 ROWS BUTYL RUBBER SEALANT UNDER COLLAR UNDER COLLAR BEFORE TIGHTENING

MADE IN HALF-SECTIONS AND FIELD-BOLTED WITH SMOOTH COLLARS

BOLT DOWN SECURELY TO ELIMINATE GAPS (TYP) 6-1/2" DIA. S.S. BOLTS

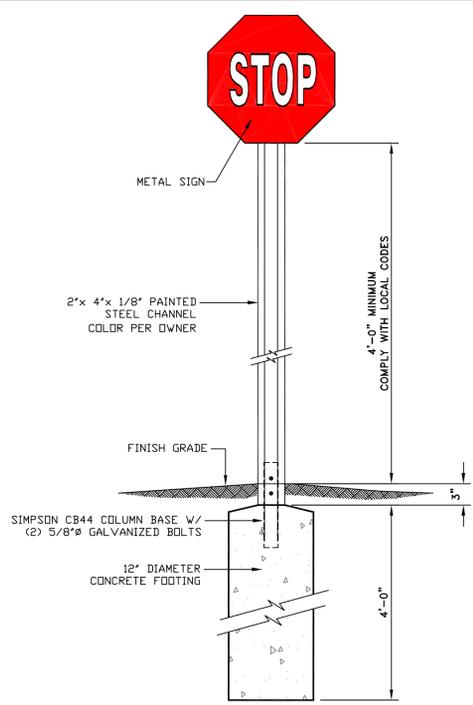


TYPICAL STOP SIGN
NOT TO SCALE

SPECIFICATIONS


UPON FINAL GRADING, THE DISTURBED AREAS SHALL BE IMMEDIATELY SEEDED TO PERMANENT VEGETATION AND MULCHED. THE DITCH WILL NOT BE UTILIZED AS AN OUTLET UNTIL A DENSE, VIGOROUS VEGETATIVE COVER HAS BEEN OBTAINED. NETTING OR EXCELSIOR MESH SHALL BE INSTALLED AT THE BASE OF THE VEGETATIVE CHANNEL.

MAINTENANCE

MOW WATERWAY AT LEAST ONCE ANNUALLY. WHEN PRACTICAL, DELAY MOWING UNTIL AFTER JULY 15TH TO ACCOMMODATE GROUND NESTING WILDLIFE. MOW TO A HEIGHT OF 4 TO 6 INCHES TO HELP MAINTAIN GOOD SURFACE PROTECTION. EXCESSIVE GROWTH SHALL BE REMOVED. DO NOT MOW LATER THAN 30 DAYS PRIOR TO THE FIRST KILLING FROST.

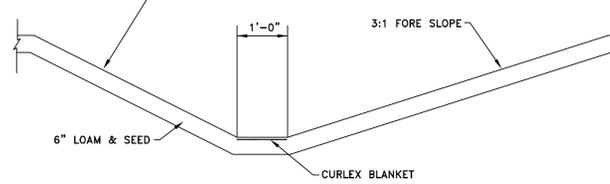


SEEDED DITCH DETAIL
NOT TO SCALE

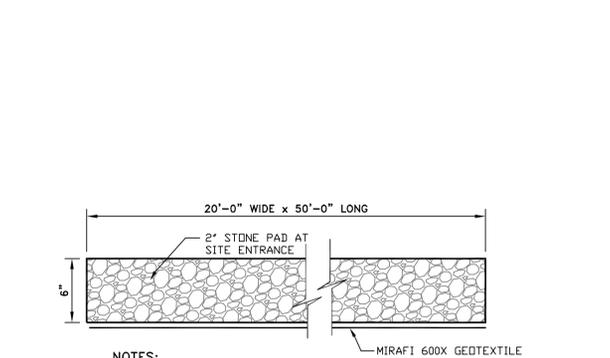


NOTES:
1. THE ENTRANCE SHALL BE MAINTAINED IN A CONDITION WHICH WILL PREVENT TRACKING OF SEDIMENT ONTO ROAD.


STABILIZED CONSTRUCTION ENTRANCE
NOT TO SCALE

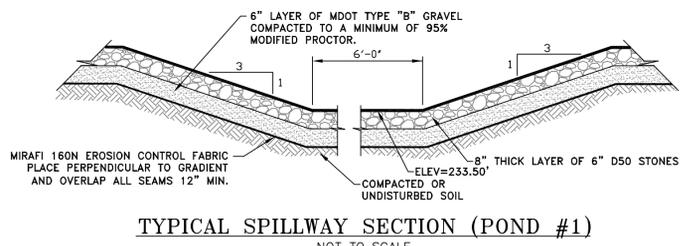

TYPICAL SPILLWAY SECTION (POND #1)
NOT TO SCALE

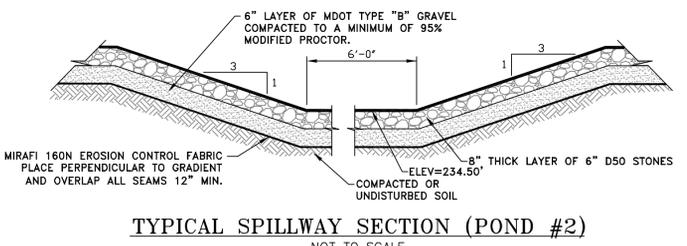

TYPICAL SPILLWAY SECTION (POND #2)
NOT TO SCALE

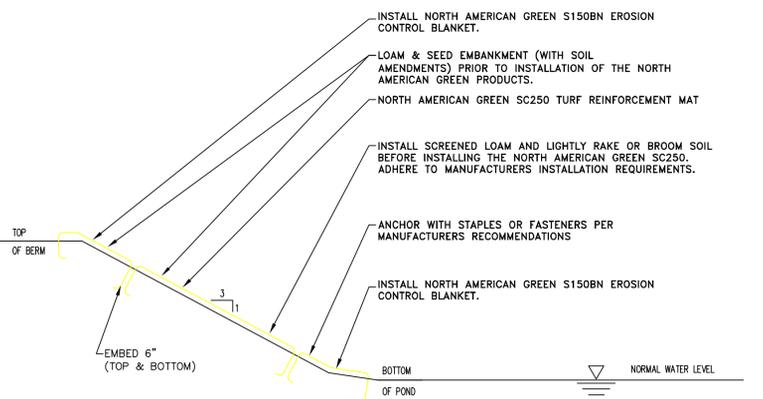

PROTECTIVE LINING AT POND FILL SLOPE (BOTH SIDES)
NOT TO SCALE



E.S. COFFIN
ENGINEERING & SURVEYING, INC.
432 Corn Road, P.O. Box 467, Augusta, Maine 04330
Ph: (207) 625-9473 Fax: (207) 625-9976 Toll Free: 1-800-248-9473

NO.	REVISIONS	DATE

SHEET TITLE:	SITE DETAILS II		
	SCALE:	AS SHOWN	DRAWN BY: TCH CHECKED BY: JEC
CLIENT/PROJECT:	THREE MAINERS LLC		
LOCATION:	BOOKER ROAD	COUNTY:	KENNEBEC STATE: MAINE
TOWN:	GARDNER	DATE:	JANUARY 22, 2026
PROJ. NO.	2024-110		
C-3			

GENERAL NOTES

1. AGGREGATE FOR GRAVEL BASE

AGGREGATE FOR GRAVEL BASE SHALL BE SCREENED OR CRUSHED GRAVEL OF HARD DURABLE PARTICLES FREE FROM VEGETABLE MATTER, LUMPS OR BALLS OF CLAY AND OTHER DELETERIOUS SUBSTANCES. THE GRADATION OF THE PART THAT PASSES A 3 INCH SIEVE SHALL MEET THE GRADING REQUIREMENTS OF THE FOLLOWING TABLE:

SIEVE DESIGNATION	PERCENTAGE BY WEIGHT PASSING SQUARE MESH SIEVES		
	TYPE A	TYPE D	STRUCTURAL AGGREGATE FILL
2" / 3" / 4"	100 (2")	100 (3")	100 (4")
1/2 INCH	45-70	35-80	90-100
1/4 INCH	30-55	25-65	25-90
No. 40	0-20	0-30	0-30
No. 200	0-6	0-7	0-5

TYPE "A" AGGREGATE SHALL NOT CONTAIN PARTICLES WHICH WILL NOT PASS THE 2 INCH SQUARE MESH SIEVE.

TYPE "D" AGGREGATE SHALL NOT CONTAIN PARTICLES WHICH WILL NOT PASS THE 6 INCH SQUARE MESH SIEVE.

EACH LAYER AS APPLIED SHALL BE ROLLED WITH A 20 TON ROLLER. THE MATERIAL AS SPREAD SHALL BE WELL MIXED WITH NO POCKETS OF EITHER FINE OR COARSE MATERIAL. OVER SIZED STONES SHALL BE REMOVED FROM THE AGGREGATE.

EACH LAYER OF AGGREGATE SHALL BE PLACED OVER THE FULL WIDTH OF THE SECTION. AGGREGATE BASE AND SUB-BASE COURSES MAY BE PLACED UPON FROZEN SURFACES WHEN SUCH SURFACES HAVE BEEN PROPERLY CONSTRUCTED.

THE SURFACE OF EACH LAYER SHALL BE MAINTAINED DURING COMPACTION OPERATIONS IN SUCH A MANNER THAT A UNIFORM TEXTURE IS PRODUCED AND THE AGGREGATE IS FIRMLY KEYS. THE MOISTURE CONTENT OF THE MATERIAL SHALL BE MAINTAINED AT THE PROPER PERCENT TO ATTAIN THE REQUIRED COMPACTION AND STABILITY. COMPACTION OF EACH LAYER SHALL BE CONTINUED UNTIL DENSITY OF NOT LESS THAN 95 PERCENT OF THE MAXIMUM DRY DENSITY AS DETERMINED BY ASTM D-1557 "MODIFIED PROCTOR DENSITY" HAS BEEN ACHIEVED FOR THE FULL WIDTH AND DEPTH OF EACH LAYER AS APPLIED.

THE SURFACE TOLERANCE OF EACH BASE COURSE AS APPLIED SHALL BE 3/8 INCHES ABOVE OR BELOW THE REQUIRED TEMPLATE LINES.

2. AGGREGATE FOR SUB-BASE


AGGREGATE FOR SUB-BASE SHALL BE TYPE "D" (MDOT). IT SHALL BE FREE FROM VEGETABLE MATTER, LUMPS OR BALLS OF CLAY AND OTHER DELETERIOUS SUBSTANCES.

3. COMMON BORROW


COMMON BORROW SHALL CONSIST OF EARTH, SUITABLE FOR EMBANKMENT CONSTRUCTION. IT SHALL BE FREE FROM FROZEN MATERIAL, PERISHABLE RUBBISH, PEAT AND OTHER UNSUITABLE MATERIAL.

THE MOISTURE CONTENT SHALL BE SUFFICIENT TO PROVIDE THE REQUIRED COMPACTION AND STABLE EMBANKMENT. IN NO CASE SHALL THE MOISTURE CONTENT EXCEED 4 PERCENT ABOVE OPTIMUM.


ALL COMMON BORROW AND GRAVEL AREAS TO BE COMPACTED TO 95% OF ITS MAX. DRY DENSITY AS DETERMINED BY ASTM D-1557 "MODIFIED PROCTOR DENSITY". PLACE IN 9" TO 12" LIFTS.

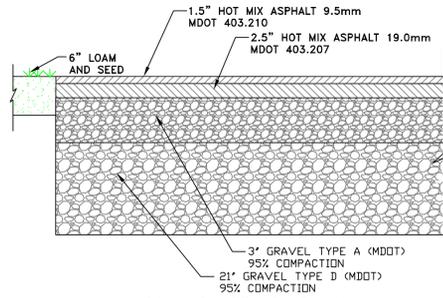


PAVED ROAD DETAIL
NOT TO SCALE

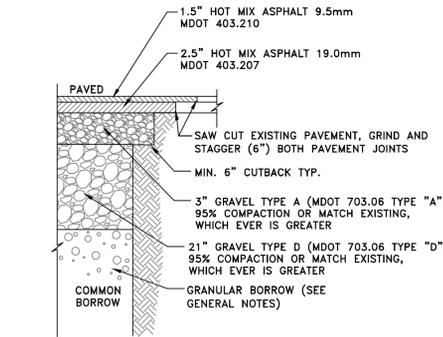

BUTT JOINT DETAIL
NOT TO SCALE

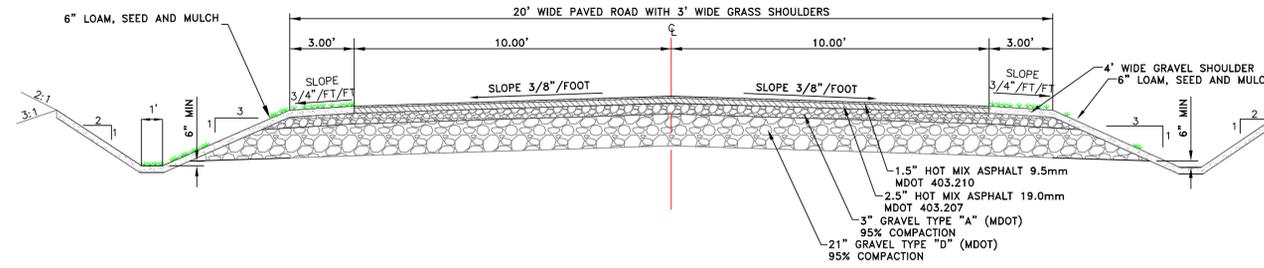


20' WIDE CROWNED ROAD SECTION
NOT TO SCALE

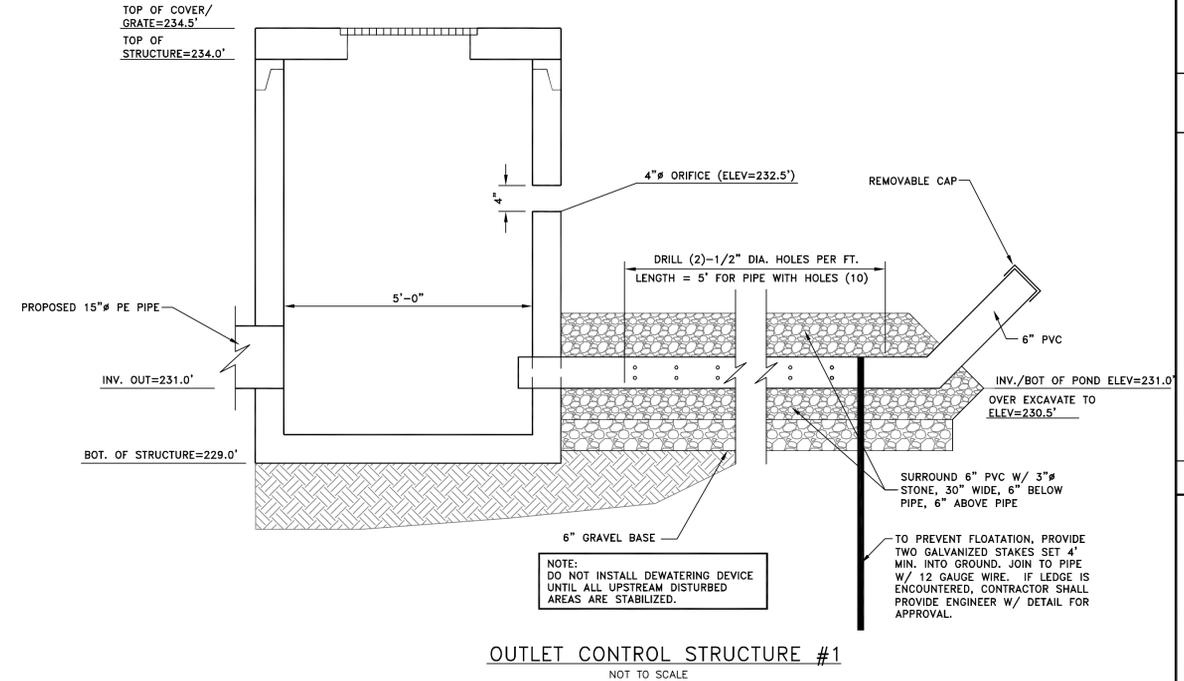


OUTLET CONTROL STRUCTURE #1
NOT TO SCALE

TRENCH NOTES:


- CONTRACTOR SHALL COMPLY WITH OCCUPATIONAL SAFETY & HEALTH ADMINISTRATION REGULATIONS PERTAINING TO THE EXCAVATION OF ALL TRENCHES. CONTRACTOR SHALL ALLOW FOR PAYMENT OF ADDITIONAL EXCAVATION, TRENCH BOXES AND BACKFILL WITH REGARD TO COMPLYING WITH ALL OCCUPATIONAL SAFETY & HEALTH ADMINISTRATION STANDARDS.
- ALL COMMON BORROW AND GRAVEL AREAS TO BE COMPACTED TO 95% OF ITS MAXIMUM DRY DENSITY AS DETERMINED BY ASTM D-1557 "MODIFIED PROCTOR DENSITY". PLACE IN 9" TO 12" LIFTS.

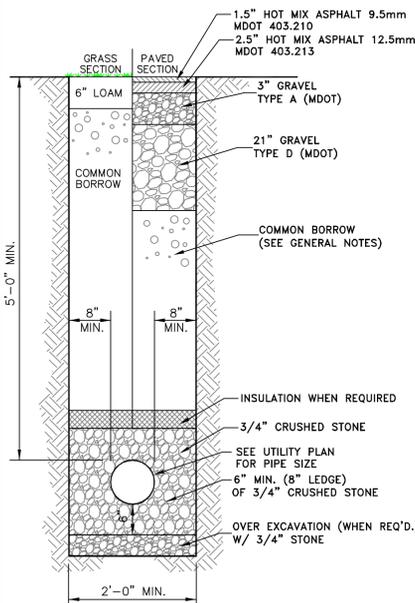


TYPICAL SANITARY TRENCH SECTION
NOT TO SCALE

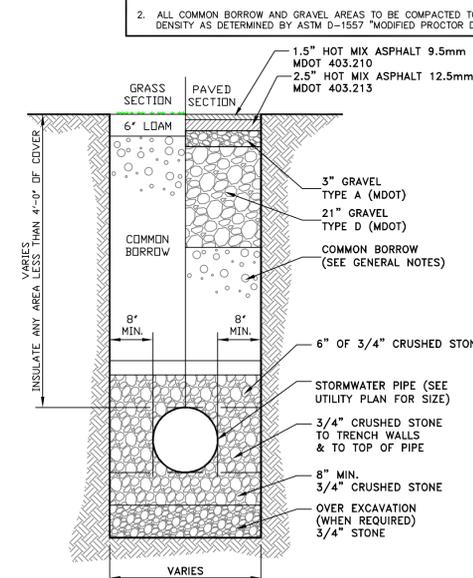

TYPICAL STORMWATER TRENCH SECTION
NOT TO SCALE

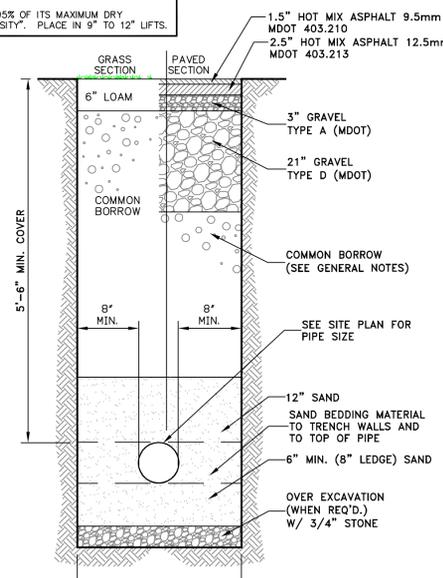

WATER SERVICE TRENCH SECTION
NOT TO SCALE

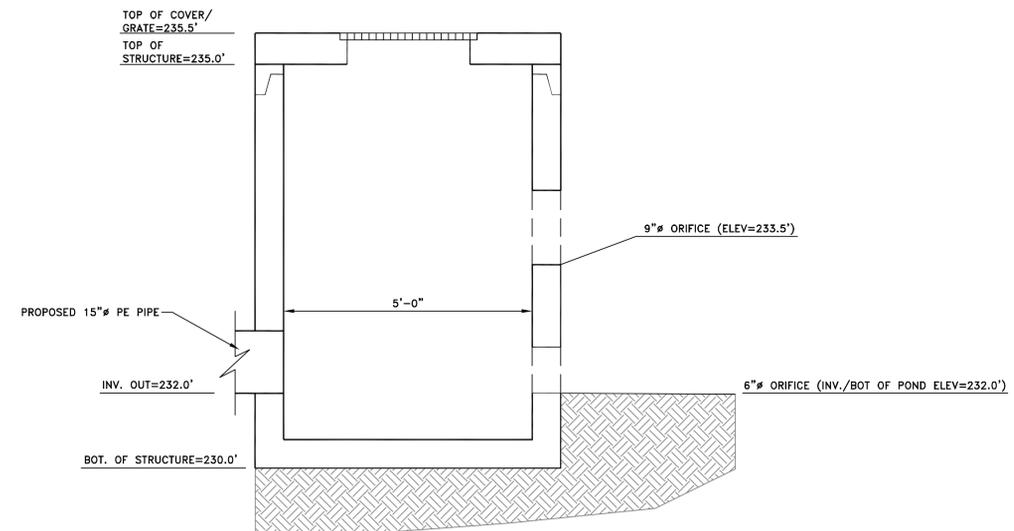


OUTLET CONTROL STRUCTURE #2
NOT TO SCALE




NO.	REVISIONS	DATE

THREE MAINERS LLC
 CLIENT/PROJECT: **BOOKER ROAD**
 LOCATION: **GARDNER** COUNTY: **KENNEBEC** STATE: **MAINE**
 SCALE: **AS SHOWN**
 DRAWN BY: **TCH** CHECKED BY: **JEC**
 DATE: **JANUARY 22, 2026**
 PROJ. NO. **2024-110**
C-4

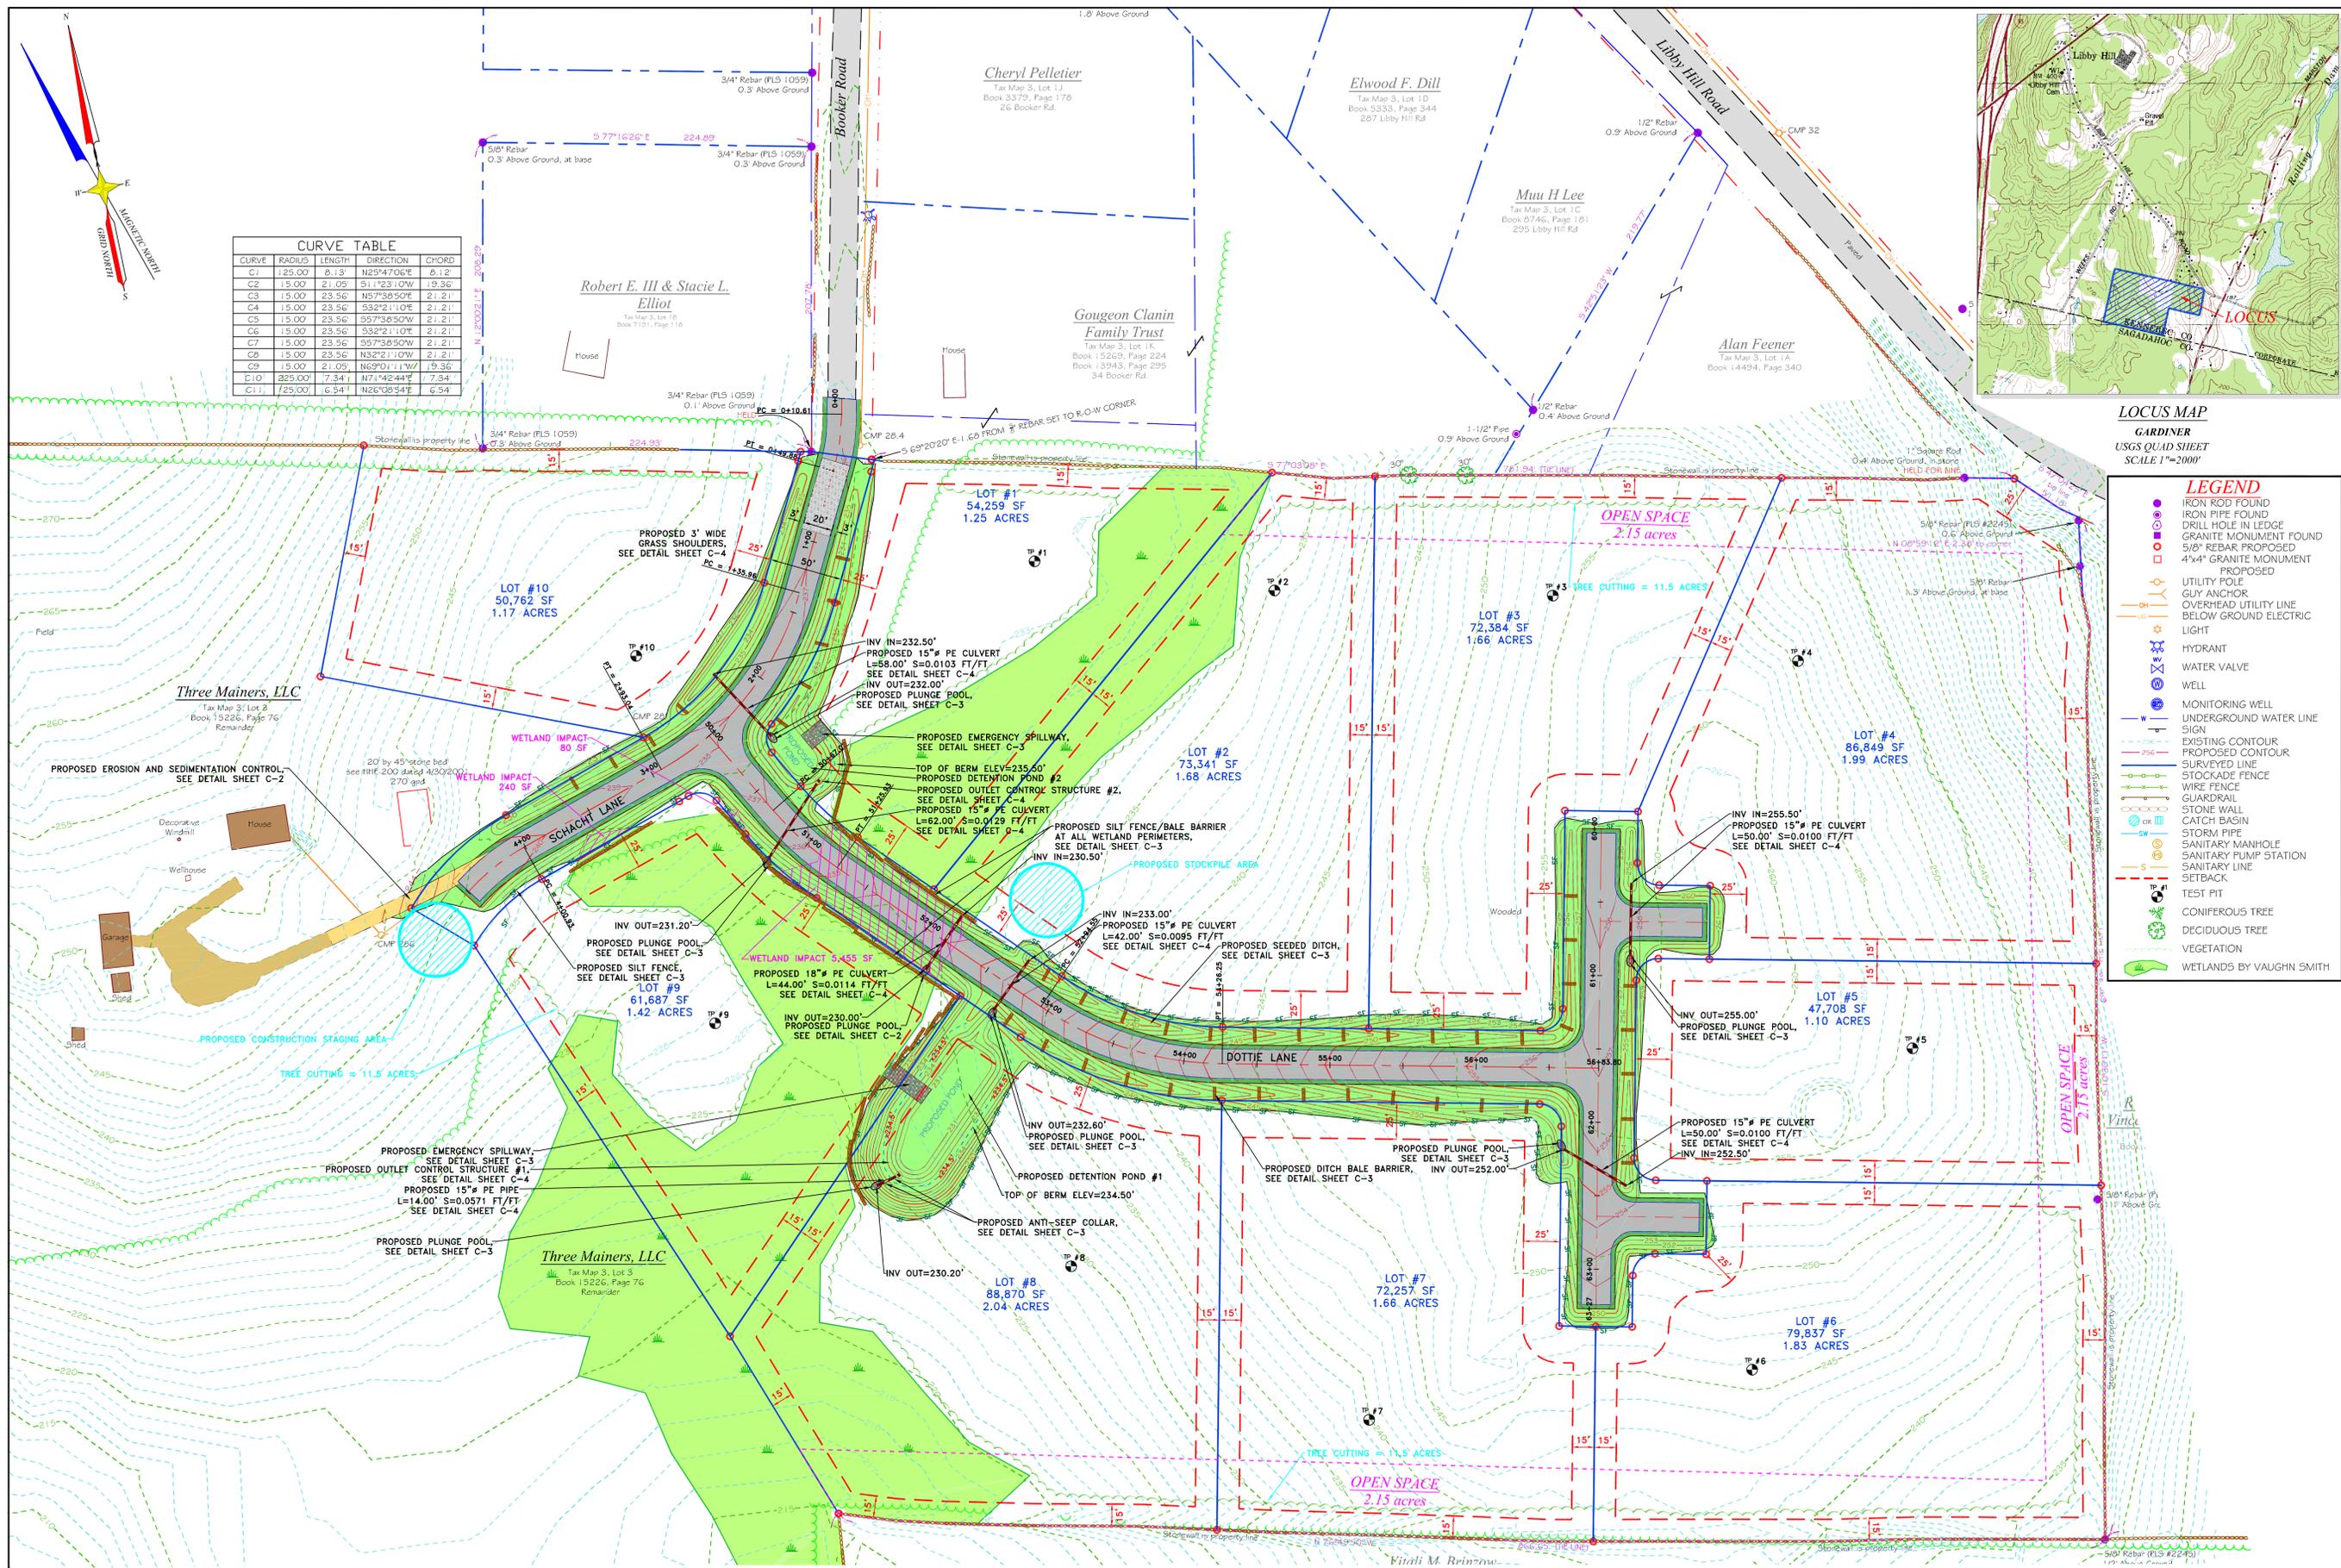


CURVE	RADIUS	LENGTH	DIRECTION	CHORD
C1	125.00	8.13	N25°47'06"E	81.22
C2	15.00	21.05	S11°23'10"W	19.36
C3	15.00	23.56	N57°38'50"E	21.21
C4	15.00	23.56	S32°21'10"E	21.21
C5	15.00	23.56	S57°38'50"W	21.21
C6	15.00	23.56	S32°21'10"E	21.21
C7	15.00	23.56	S57°38'50"W	21.21
C8	15.00	23.56	N32°21'10"W	21.21
C9	15.00	21.05	N69°01'11"W	19.36
C10	825.00	7.34	N71°42'44"E	7.34
C11	725.00	6.54	N26°08'54"E	6.54

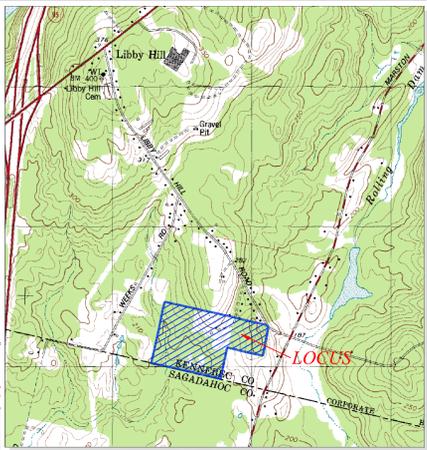

LOCUS MAP
GARDINER
USGS QUAD SHEET
SCALE 1"=2000'

LEGEND	
	IRON ROD FOUND
	IRON PIPE FOUND
	DRILL HOLE IN LEDGER
	GRANITE MONUMENT FOUND
	5/8" REBAR PROPOSED
	4x4" GRANITE MONUMENT PROPOSED
	UTILITY POLE
	GUY ANCHOR
	OVERHEAD UTILITY LINE
	BELOW GROUND ELECTRIC
	LIGHT
	HYDRANT
	WATER VALVE
	WELL
	MONITORING WELL
	UNDERGROUND WATER LINE
	SIGN
	EXISTING CONTOUR
	PROPOSED CONTOUR
	SURVEYED LINE
	STOCKADE FENCE
	WIRE FENCE
	GUARDRAIL
	STONE WALL
	CATCH BASIN
	STORM PIPE
	SANITARY MANHOLE
	SANITARY PUMP STATION
	SANITARY LINE
	SETBACK
	TEST PIT
	CONIFEROUS TREE
	DECIDUOUS TREE
	VEGETATION
	WETLANDS BY VAUGHN SMITH



THIS PLAN PRELIMINARY
KANE
C.P. #1291
PROFESSIONAL LAND SURVEYOR
WITHOUT SIGNATURE

E.S. COFFIN
ENGINEERING & SURVEYING, INC.
432 Camp Road, Chelsea, Maine 04330
Phone (207) 653-9442 Fax (207) 653-9016

NO.	REVISIONS	DATE

SHEET TITLE: **EROSION CONTROL PLAN**
SCALE: 1 INCH=50 FEET
DRAWN BY: TCH
CHECKED BY: JEC

CLIENT/PROJECT: **THREE MAINERS LLC
SUNSET RIDGE SUBDIVISION**
LOCATION: **BOOKER ROAD**
TOWN: **GARDINER** COUNTY: **KENNEBEC** STATE: **MAINE**
DATE: **JANUARY 22, 2026**

PROJ. NO. 2024-110
EC